

CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

Compact device for high-precision measurement of mass and volume flow, density, temperature and concentration with just one device

Measurement made easy



The ideal transmitter for system integration

- Modbus for quick and comprehensive communication
- Two fast digital outputs that can be configured as pulse outputs, frequency outputs or binary outputs

Integrated VeriMass device verification and diagnosis

- Predictive maintenance in the process
- Extended maintenance cycles
- Reduced maintenance effort

CoriolisMaster Software Tools

- DensiMass for concentration measurements, net mass and volume flow calculations
- FillMass for filling applications

Lower pressure drop

Self-draining

Global approvals for explosion protection

MID / OIML approval for legal metrology


CoriolisMaster FCH100

- For hygienic applications
- EHEDG certified

CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

Overview – models

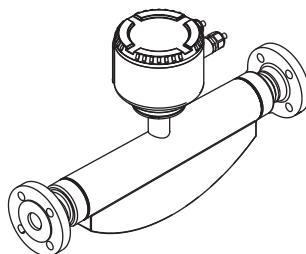

G11602

Fig. 1: FCB1xx / FCH1xx

Model number	FCB1xx for standard applications	FCH1xx for hygienic applications
Process connections		
Flange DIN 2501 / EN 1092-1	DN 10 ... 200, PN 40 ... 100	-
Flange ASME B16.5	DN 1/2" ... 8", CL150 ... CL1500	-
Pipe fitting DIN 11851	DN 10 ... 100 (1/4 ... 4")	DN 15 ... 100 (1/2 ... 4")
Tri-Clamp	DIN 32676 (ISO 2852) BPE Tri-Clamp DN 10 ... 100 (1/4 ... 4")	DIN 32676 (ISO 2852) BPE Tri-Clamp DN 10 ... 100 (1/4 ... 4")
Other connections	On request	On request
Wetted material	Stainless steel 1.4435 or 1.4404 (AISI 316L), nickel-alloy C4 / C22 (optional)	Stainless steel, polished 1.4404 (AISI 316L) or 1.4435 (AISI 316L)
Approvals and certificates		
Explosion protection ATEX / IECEx	Zone 0, 1, 2, 21, 22	Zone 0, 1, 2, 21, 22
Explosion protection conforming to cFMus	Class I Div. 1, Class I Div. 2, Zone 0, 1, 2, 21	Class I Div. 1, Class I Div. 2, Zone 0, 1, 2, 21
Hygiene approvals	-	EHEDG, FDA compliant
Legal metrology	Type-tested for legal metrology in accordance with MID / OIML R117	
Additional approvals	Available on our website abb.com/flow or on request	

Measuring accuracy for liquids	FCB130	FCB150	FCH130	FCH150
Mass flow ¹⁾	0.4 %, 0.25 % and 0.2 %	0.1 % and 0.15 %	0.4 %, 0.25 % and 0.2 %	0.1 % and 0.15 %
Volume flow ¹⁾	0.4 %, 0.25 % and 0.2 %	0.15 % and ± 0.11 %	0.4 %, 0.25 % and 0.2 %	0.15 % and ± 0.11 %
Density	0.01 kg/l	— 0.002 kg/l — 0.001 kg/l (optional) — 0.0005 kg/l	0.01 kg/l	— 0.002 kg/l — 0.001 kg/l (optional) — 0.0005 kg/l
Temperature	1 K	0.5 K	1 K	0.5 K
Measuring accuracy for gases¹⁾	1 %	0.5 %	1 %	0.5 %
Permissible measuring medium temperature	-50 ... 160 °C (-58 ... 320 °F)	-50 ... 205 °C (-58 ... 400 °F)	-50 ... 160 °C (-58 ... 320 °F)	-50 ... 205 °C (-58 ... 400 °F)
Permissible ambient temperature	-40 ... 70 °C (-40 ... 158 °F)			
Power supply	11 ... 30 V DC, nominal voltage: 24 V DC			
IP rating in accordance with EN 60529	IP 65 / IP 67 / IP 68 (immersion depth: 5 m), NEMA 4X			
Communication	Modbus RTU, RS485			
Outputs in serial production	— Digital output 1: passive — Digital output 2: passive			
External output zero return	Yes			
External totalizer reset	Yes			
Flow measurement in forward flow and reverse flow direction	Yes			
Empty pipe detection	Yes, based on preconfigured density alarm			
Self-monitoring and diagnosis	Yes			
Field optimization for flow and density	Yes			
Concentration measurement "DensiMass"	Yes, optional on models FCB150 and FCH150			
"FillMass" fill function	Yes, optional on models FCB150 and FCH150			
"VeriMass" diagnosis function	Yes, optional			

1) Indication of accuracy in % of the measured value (% of measured value)

CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

General data

Device description

The CoriolisMaster FCB130, FCB150, FCH130, FCH150 is the low-cost and simple ABB mass flowmeter with the new DSP transmitter.

The device is equipped with a Modbus interface and two fast digital outputs that can be configured as pulse outputs, frequency outputs or binary outputs.

The CoriolisMaster FCB130, FCB150, FCH130, FCH150 operates in accordance with the Coriolis principle. The design offers the following benefits:

- Space-saving, robust design.
- Variety of process connections.
- Two digital outputs.
- Communication via Modbus RTU protocol.
- Approval for use in potentially explosive atmospheres. The user can select the "i" or "e" type of protection for the output circuits; the type chosen will depend on the circuits which are connected. The type of protection can be changed even after installation has been completed.

VeriMass erosion monitor

The integrated VeriMass diagnosis function allows the status of the meter tube to be monitored. This enables changes due to material erosion and the formation of deposits on the meter tube walls to be identified at an early stage.

If the set limit value is exceeded, an alarm is triggered, e.g. via the programmable digital output or HART, depending on the configuration.

The limit value for the erosion monitor can be set either automatically or manually.

Automatic adjustment

The transmitter monitors the sensor's driver current over a prolonged period and creates a "fingerprint" for the relevant application. The transmitter generates a corresponding tolerance value for deviations in the driver current.

The transmitter compares the behavior of the driver current with the generated fingerprint and triggers the relevant error message in the event of prolonged deviations.

Manual adjustment

For applications where automatic adjustment of the erosion monitor does not provide a satisfactory result, the erosion monitor can be balanced manually.

For more information please contact ABB Service or the sales organization.

DensiMass concentration measurement

Only for FCB150 / FCH150

The transmitter can calculate the current concentration from the measured density and temperature using concentration matrices.

The following concentration matrices are preconfigured in the transmitter as standard:

- Concentration of sodium hydroxide in water
- Concentration of alcohol in water
- Concentration of sugar in water
- Concentration of maize starch in water
- Concentration of wheat starch in water

The user can enter two more user-defined matrices containing up to 100 values.

Calculating standard volumes and standard densities of liquids

If a suitable matrix is available, the DensiMass function also allows the measured volume to be corrected for any selected temperature.

The measured density can also be corrected for a given temperature.

However, this is only possible when measuring liquids and after entering an appropriate matrix.

This correction can also be performed using the default matrices (see above).

The calculated standard volumes and standard densities can also be issued for all other process variables.

The software "DensiMatrix" is available for the easy input of the matrix.

Accuracy of the concentration measurement

The accuracy of the concentration measurement is determined in the first instance by the quality of the matrix data entered. However, as the calculation is based on temperature and density (the input variables), the accuracy of the concentration measurement is ultimately determined by the measuring accuracy of the temperature and the density.

Example:

Density of 0 % alcohol in water at 20 °C (68 °F): 998.23 g/l

Density of 100 % alcohol in water at 20 °C (68 °F): 789.30 g/l

Concentration	Density
100 %	208.93 g/l
0.48 %	1 g/l
0.96 %	2 g/l

Thus, the accuracy class of the density measurement directly determines the accuracy of the concentration measurement.

CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

FillMass batch function Only for FCB150 / FCH150

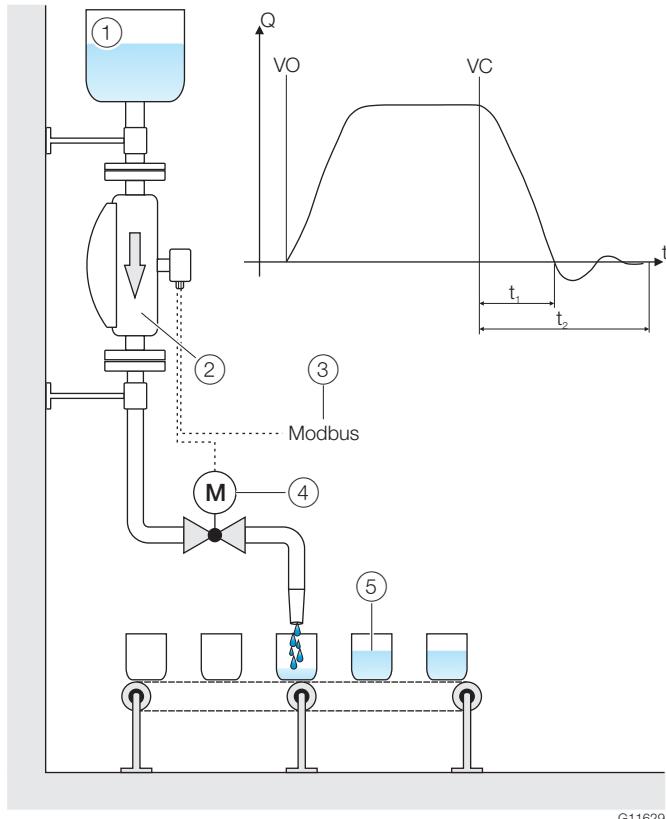


Fig. 2: FillMass batch function

- (1) Supply tank (2) Sensor
- (3) Filling start / stop switch (4) Filling valve (5) Filling tank

G11629

The integrated FillMass batch function allows filling processes to be recorded in > 3 seconds.

For this purpose, the filling quantity is given via an adjustable totalizer.

The Modbus interface is used to configure and control the fill function.

The valve is triggered via one of the digital outputs and closed again once the preset filling quantity is reached.

The transmitter measures the overrun quantity and calculates the overrun correction from this.

Additionally, the low flow cut-off can be activated if required.

Devices for legal metrology in accordance with MID/OIML R117

The Coriolis mass flowmeters CoriolisMaster FCBx50 / FCHx50 are type-tested for legal metrology in accordance with MID / OIML R117 in accuracy class 0.3.

Additional information can be found on the corresponding certificate. The certificate is available in the download area at www.abb.com/flow.

Please use the optional order code "CM1" when ordering.

Please observe the additional remarks in the operating and commissioning instruction.

Diagram key

VO	Valve open (filling started)
VC	Valve closed (fill quantity reached)
t_1	Valve closing time
t_2	Overrun time

Flowmeter sensor

General installation conditions

Installation location and assembly

Note the following points when selecting the installation location and when mounting the sensor:

- The ambient conditions (IP rating, ambient temperature range T_{amb}) of the device must be adhered to at the installation location.
- Sensors and transmitters must not be exposed to direct sunlight. If necessary, provide a suitable means of sun protection on site. The limit values for the ambient temperature T_{amb} must be observed.
- On flange devices, ensure that the counterflanges of the piping are aligned plane parallel. Only install flange devices with suitable gaskets.
- Prevent the sensor from coming into contact with other objects.
- The device is designed for industrial applications. No special EMC protective measures are required if the electromagnetic fields and interference at the installation location of the device comply with "Best Practice" guidelines (in accordance with the standards referred to in the declaration of conformity). Maintain a suitable distance from electromagnetic fields and interference that extend beyond the usual dimensions.

Gaskets

Users are responsible for selecting and mounting suitable gaskets (material, shape).

Note the following points when selecting and mounting gaskets:

- Only gaskets made from a material that is compatible with the measuring medium and measuring medium temperature may be used
- Gaskets must not extend into the flow area, since possible turbulence may influence the accuracy of the device.

Calculating pressure loss

Pressure loss is determined by the properties of the medium and the flow.

Documents to help with the calculation of pressure loss can be accessed from www.abb.com/flow-selector.

Brackets and supports

No special supports or damping are required for the device when the device is used and installed as intended.

In systems designed in accordance with "Best Practice" guidelines, the forces acting on the device are already sufficiently absorbed. This is also true of devices installed in series or in parallel.

For heavier devices, it is advisable to use additional supports / brackets on site. Doing this prevents damage to the process connections and piping from lateral forces.

Please observe the following points:

- Mount two supports or brackets symmetrically in the immediate vicinity of the process connections.
- Do not attach any supports or brackets to the flowmeter sensor housing.

Inlet section

The sensor does not require any inlet section.

The devices can be installed directly before/after manifolds, valves or other equipment, provided that no cavitation is caused by this equipment.

Mounting position

The flowmeter operates in any mounting position.

Depending on the measuring medium (liquid or gas) and the measuring medium temperature, certain mounting positions are preferable to others. For this purpose, consider the following examples.

The preferred flow direction is indicated by the arrow on the sensor. The flow will be displayed as positive.

The specified measuring accuracy can be achieved only in the calibrated flow direction (for forward flow calibration, this is only in the direction of the arrow; for the optional forward flow and reverse flow calibration, this can be in both flow directions).

CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

Liquid measuring media

Observe the following points to avoid measuring errors:

- The meter tubes must always be completely filled with the measuring medium.
- The gases dissolved in the measuring medium must not leak out. To safeguard this, a minimum back pressure of 0.2 bar (2.9 psi) is recommended.
- The minimum vapor pressure of the measuring medium must be maintained when there is negative pressure in the meter tube or when liquids are gently simmering.
- During operation, there must be no phase transitions in the measuring medium.

Vertical installation

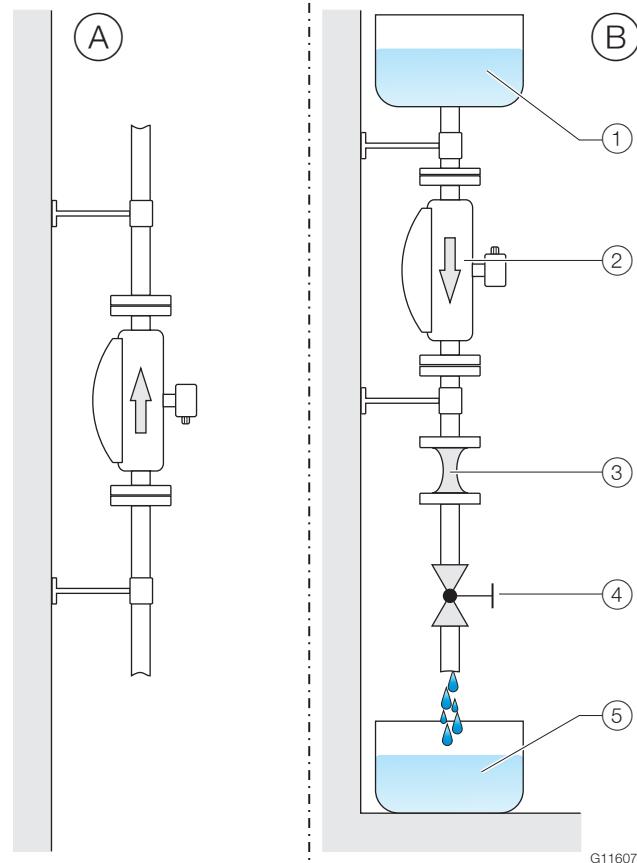


Fig. 3: Vertical installation

- (1) Storage tank (2) Sensor (3) Pipe contraction / orifice plate
(4) Isolating device (5) Fill container

(A) Vertical installation in riser

For vertical installation in a riser, no special measures are required.

(B) Vertical installation in a drop line

For vertical installation in a downpipe, a piping constriction or an orifice plate must be installed below the sensor. Doing this prevents the sensor from draining during the measurement.

Horizontal installation

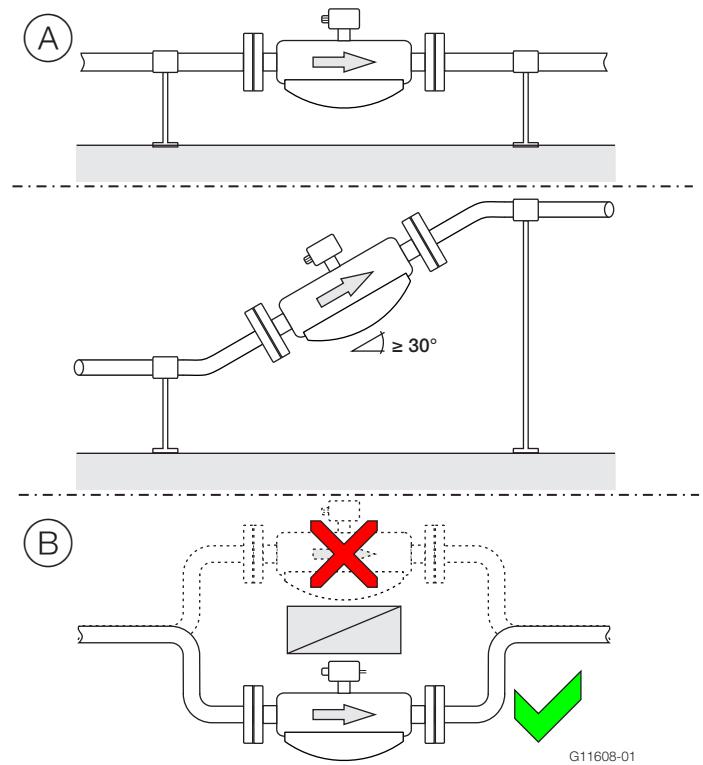


Fig. 4 Horizontal installation

- (A) For liquid measuring media and horizontal installation, the transmitter and terminal box must point upward. If a self-draining installation is required, the sensor must be mounted at an incline of $\geq 30^\circ$.
- (B) Installing the sensor at the highest point of the piping leads to an increased number of measuring errors due to the accumulation of air or the formation of gas bubbles in the meter tube.

Gaseous measuring media

Observe the following points to avoid measuring errors:

- Gases must be dry and free of liquids and condensates.
- Avoid the accumulation of liquids and the formation of condensate in the meter tube.
- During operation, there must be no phase transitions in the measuring medium.

If there is a risk of condensate formation when using gaseous measuring media, note the following:

Ensure that condensates cannot accumulate in front of the sensor.

If this cannot be avoided, we recommend that the sensor is installed vertically with a downward flow direction.

Vertical installation

For vertical installation, no special measures are required.

Horizontal installation

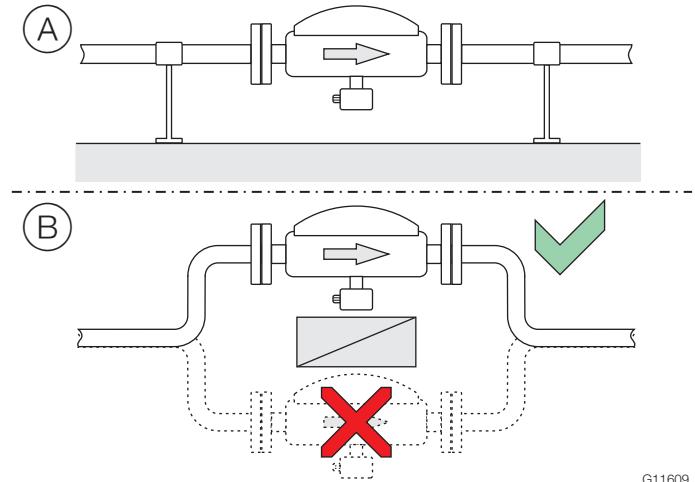


Fig. 5 Horizontal installation

- (A) For gaseous measuring media and horizontal installation, the transmitter and terminal box must point downward.
- (B) Installing the sensor at the lowest point of the piping leads to an increased number of measuring errors due to the accumulation of liquid or the formation of condensates in the meter tube.

Sensor insulation

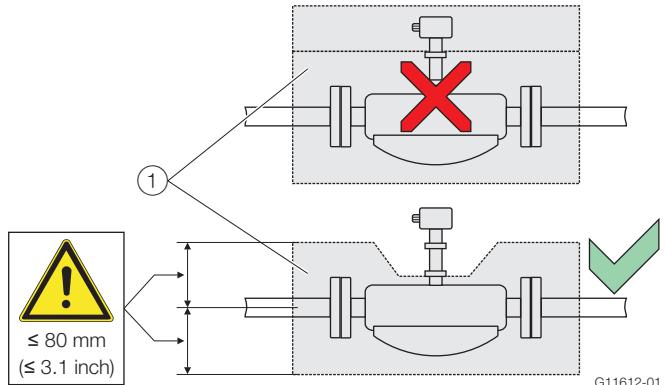


Fig. 6: Installation when T_{medium} is $-50 \dots 205^{\circ}\text{C}$ ($-58 \dots 400^{\circ}\text{F}$)

① Insulation

The sensor may be insulated only in conjunction with option TE1 "Tower length extension - meter insulation capability" or TE2 "Tower length extension - meter insulation capability with double sealing", as shown in Fig. 6.

CoriolisMaster FCB130, FCB150, FCH130, FCH150 Coriolis mass flowmeter

Turn-off devices for zero point adjustment

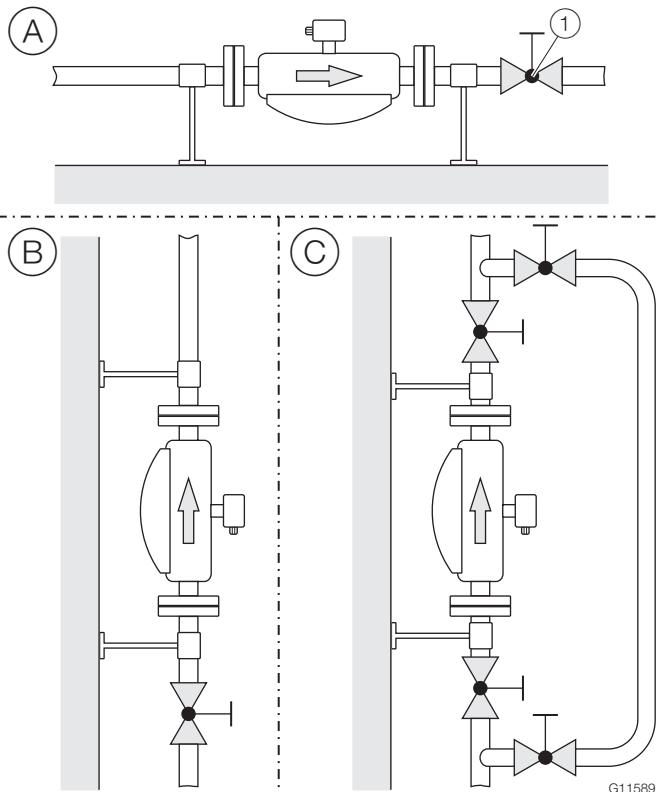


Fig. 7: Mounting options for turn-off devices (example)

① Turn-off device

To guarantee the conditions for zero point adjustment under operating conditions, turn-off devices are required in the piping:

- (A) At least on the outlet side when the transmitter is mounted in horizontal position.
- (B) At least on the inlet side when the transmitter is mounted in vertical position.
- (C) In order to perform adjustment during an ongoing process, it is advisable to mount a bypass pipe as shown.

Installation in EHEDG-compliant installations


WARNING

Risk of poisoning!

Bacteria and chemical substances can contaminate or pollute pipeline systems and the materials they are made of. In EHEDG-compliant installations, the instructions below must be observed.

- The required self-draining functionality of the sensor can only be guaranteed when the vertical mounting position or horizontal mounting position at a 30° incline is used. See also chapter "Liquid measuring media" on page 8.
- The combination of process connections and gaskets selected by the operator may comprise only EHEDG-compliant components. Please note the information in the latest version of the EHEDG Position Paper: "Hygienic Process connections to use with hygienic components and equipment" in this regard.
- The pipe fitting in accordance with DIN 11851 is approved for use in conjunction with an EHEDG-compliant gasket.

Designs

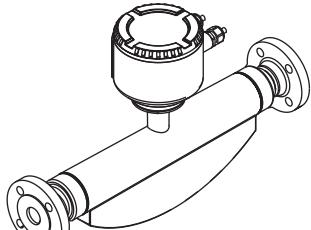

G11602

Fig. 8: Sensor

Nominal diameter and measuring range

Nominal diameter	Q_{\max} in kg/h (lb/h)
DN 15 (1/2")	0 ... 8,000 (0 ... 17,637)
DN 25 (1")	0 ... 35,000 (0 ... 77,162)
DN 50 (2")	0 ... 90,000 (0 ... 198,416)
DN 80 (3")	0 ... 250,000 (0 ... 551,156)
DN 100 (4")	0 ... 520,000 (0 ... 1,146,404)
DN 150 (6")	0 ... 860,000 (0 ... 1,895,975)

Recommended flow range

Fluids:

- The recommended flow range is 5 ... 100 % of Q_{\max} .
- Flows < 1 % of Q_{\max} should be avoided.

Gases:

- The flow velocity of gases in the meter tube should not exceed 0.3 Mach (approx. 100 m/s (328 ft/s)).
- Flow velocities above 80m/s may lead to increased repeatability values.
- The maximum flow range of gases is determined by the operating density. Dimensioning guidelines are available at www.abb.com/flow.

Measuring accuracy

Reference conditions

Calibration fluid	Water – Temperature: 25 °C (77 °F) ± 5 K – Pressure 2 ... 4 bar (29 ... 58 psi)
Ambient temperature	25 °C (77 °F) +10 K / -5 K
Power supply	Line voltage according to name plate $U_N \pm 1 \%$
Warm-up phase	30 minutes
Installation	<ul style="list-style-type: none"> – Installation in accordance with the "Assembly notes" and "Installation position" chapters. – No visible gas phase – No external mechanical or hydraulic disturbances, particularly no cavitation
Output calibration	Pulse output

Measured error and repeatability

The measured error and repeatability are calculated as follows for the flow:

Scenario 1:

If

$$\text{Flow rate} \geq \frac{\text{Zero stability}}{(\text{base accuracy} / 100)}$$

Then:

- Maximum measured error:
± base accuracy as % of measured value.
- Repeatability:
± 1/2 x base accuracy as % of measured value.

Scenario 2:

If

$$\text{Flow rate} < \frac{\text{Zero stability}}{(\text{base accuracy} / 100)}$$

Then:

- Maximum measured error:
± (zero stability / measured value) x 100 % of measured value
- Repeatability:
± 1/2 x (zero stability / measured value) x 100% of measured value.

CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

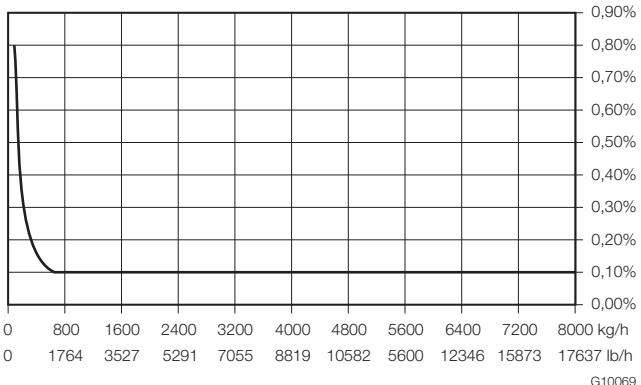


Fig. 9: Measured error FCx150 DN 15 (Example)

FCx150

Measurement dynamic	Flow rate	Measured error ¹⁾	Repeatability ¹⁾
100:1	80 kg/h (176,4 lb/h)	≤ 0,8 %	0,4 %
50:1	160 kg/h (352,7 lb/h)	≤ 0,4 %	0,2 %
10:1	800 kg/h (1763,7 lb/h)	≤ 0,1 %	0,05 %
2:1	4000 kg/h (8818,5 lb/h)	≤ 0,1 %	0,05 %
1:1	8000 kg/h (17637 lb/h)	≤ 0,1 %	0,05 %

FCx150 – high accuracy

Measurement dynamic	Flow rate	Measured error ¹⁾	Repeatability ¹⁾
100:1	80 kg/h (176,4 lb/h)	≤ 0,5 %	0,25 %
50:1	160 kg/h (352,7 lb/h)	≤ 0,25 %	0,122 %
10:1	800 kg/h (1763,7 lb/h)	≤ 0,1 %	0,05 %
2:1	4000 kg/h (8818,5 lb/h)	≤ 0,1 %	0,05 %
1:1	8000 kg/h (17637 lb/h)	≤ 0,1 %	0,05 %

1) Enter measured error and repeatability as % of measured value

Measured error and base accuracy for liquids			
	FCx130	FCx150	FCx150 – high accuracy
Order code flow calibration	A, B, E, J, K, N	C, D, L, M	D, M
Order code density calibration	1	3, 4	5
Mass flow ¹⁾	± 0,4 % ± 0,25 % ± 0,2 %	± 0,15 % ± 0,1 %	± 0,1 %
Volume flow ¹⁾	± 0,4 % ± 0,25 % ± 0,2 %	± 0,15 %	± 0,11 %
Density	0,010 kg/l ²⁾ 0,002 kg/l ²⁾ 0,001 kg/l ²⁾	0,002 kg/l ²⁾ 0,0005 kg/l ²⁾	0,0005 kg/l ²⁾
Repeatability for flow rate	See chapter "Measured error and repeatability" on page 11.		
Repeatability for density	0,002 kg/l ²⁾ 0,001 kg/l ²⁾	0,002 kg/l ²⁾ 0,001 kg/l ²⁾	0,00025 kg/l ²⁾
Temperature	1 K	0,5 K	0,2 K
Measured error and base accuracy for gases			
	FCx130	FCx150	FCx150 – high accuracy
Order code flow calibration	A, B, E, J, K, N	C, D, L, M	D, M
Order code density calibration	1	3, 4	5
Mass flow ¹⁾	± 1 %	± 0,5 %	± 0,5 %
Temperature	1 K	0,5 K	0,2 K

1) Enter measured error and base accuracy as % of measured value

2) For the density range from 0,5 ... 1,8 kg/dm³

Zero stability

Nominal diameter	FCx130	FCx150	FCx150 – high accuracy
Order code flow calibration	A, B, E, J, K, N	C, D, L, M	D, M
Order code density calibration	1	3, 4	5
DN 15 (1/2")	0.64 kg/h (1.41 lb/h)	0.4 kg/h (0.88 lb/h)	
DN 25 (1")	2.16 kg/h (4.76 lb/h)	1.35 kg/h (2.98 lb/h)	
DN 50 (2")	7.20 kg/h (15.87 lb/h)	4.5 kg/h (9.92 lb/h)	
DN 80 (3")	20 kg/h (44 lb/h)	20 kg/h (44 lb/h)	
DN 100 (4")	41.6 kg/h (91.7 lb/h)	41.6 kg/h (91.7 lb/h)	
DN 150 (6")	68.8 kg/h (151.68 lb/h)	68.8 kg/h (151.68 lb/h)	

Effect of the medium temperature

	FCx130	FCx150	FCx150 – high accuracy
Order code flow calibration	A, B, E, J, K, N	C, D, L, M	D, M
Order code density calibration	1	3, 4	5
On flow rate	less than $\pm 0.0015\%$ of $Q_{max} / 1\text{ K}$	less than $\pm 0.0004\%$ of $Q_{max} / 1\text{ K}$	
On density	less than 0.0001 kg/dm^3 per 1 K	less than 0.0001 kg/dm^3 per 1 K	

Effect of the operating pressure

Nominal diameter	Flow rate ¹⁾	Density [kg/dm ³ / bar]
DN 15 (1/2")	-0.002 %	No effect
DN 25 (1")	-0.013 %	0.00035
DN 50 (2")	-0.010 %	0.00027
DN 80 (3")	-0.006 %	0.00019
DN 100 (4")	-0.009 %	0.00024
DN 150 (6")	-0.035 %	0.00045

1) Influence of operating pressure as % of measured value per bar

Specifications

Pressure loss

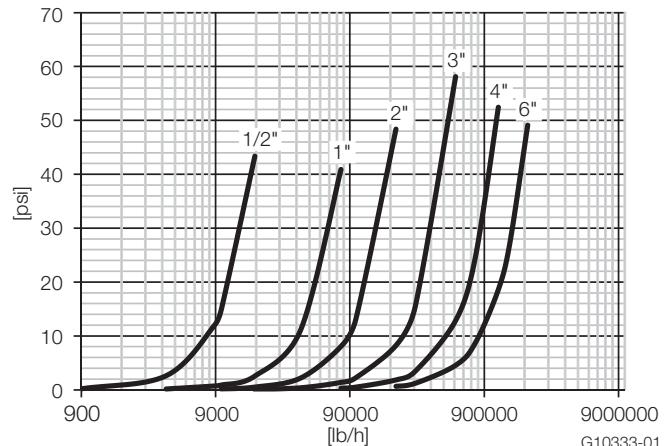
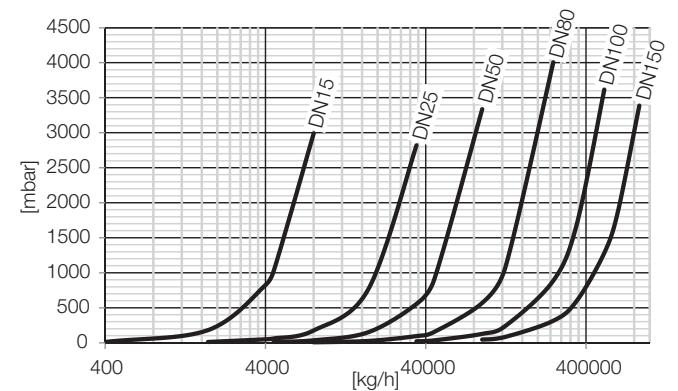


Fig. 10: Pressure loss curve (measured with water, viscosity: 1 mPas)

Viscosity range

If you are working with dynamic viscosities $\geq 1\text{ Pas}$ ($1000\text{ mPas} = 1000\text{ cP}$), please contact ABB.

CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

Temperature limits °C (°F)

NOTICE

When using the device in potentially explosive atmospheres, note the additional data in chapters "Use in potentially explosive atmospheres according to ATEX and IECEx" on page 41 and "Use in potentially explosive atmospheres in accordance with cFMus" on page 47!

Measuring medium temperature T_{medium}

- FCx130: -50 ... 160 °C (-58 ... 320 °F)
- FCx150: -50 ... 205 °C (-58 ... 401 °F)

In devices with order code "Extended tower length – TE3", the measuring medium temperature must be limited to a maximum of 140 °C (284 °F) from an ambient temperature of $\geq 65^{\circ}\text{C}$ (149 °F).

Ambient temperature $T_{\text{amb.}}$

-40 ... 70 °C (-40 ... 158 °F)

Process connections

For an overview of the available process connection variants, see the chapter entitled "Overview – models" on page 2.

Pressure rating

The maximum permissible operating pressure is determined by the respective process connection, the temperature of the medium to be measured, the screws, and the gasket material. For an overview of the available pressure ratings, see the chapter entitled "Overview – models" on page 2.

Enclosure as protective device (optional)

Oder Code PR5

- Maximum burst pressure 60 bar (870 psi).

Optional Oder Code PR6 and PR7 on request

- Increased burst pressures up to 100 bar (1450 psi), possible for nominal diameters DN 15 ... 100 (1/2" ... 4").
- Increased burst pressures up to 150 bar (2175 psi), possible for nominal diameters DN 15 ... 80 (1/2" ... 3").
- Flushing connections are available on request.

Pressure Equipment Directive

Conformity assessment according to Category III, fluid group 1, gas

Note the corrosion resistance of the meter tube materials in relation to the measuring medium.

Installation lengths in accordance with NAMUR standards

The CoriolisMaster FCB130, FCB150, FCH130, FCH150 is the ideal device for use in accordance with NAMUR standards. While also conforming to other standards, the device can be ordered with installation lengths in accordance with NAMUR standards. The corresponding ordering option is S5. The exact lengths can be found in the tables in the chapter entitled "Devices DN 15 ... 150 in NAMUR standard installation lengths" on page 28.

Materials for the transmitter terminal box

Housing

- Aluminum EN AC-44200 (YL104)
- or
- Stainless steel 1.4409 (ASTM CF3M)

Housing color

- Center section: RAL 7012
- Cover: RAL 9002

Varnish layer thickness: 80 ... 120 µm

Materials for the sensor

Wetted components

Stainless steel

- 1.4404 (AISI 316L)

Stainless steel, polished

- 1.4404 (AISI 316L) or 1.4435 (AISI 316L) certified in accordance with EHEDG with sensor material (AISI 316L)
- C4 nickel alloy¹⁾ (2.4610) or C22 nickel alloy¹⁾ (2.4602)

Optional: Manufacture in accordance with NACE MR0175 and MR0103 (ISO 15156)

Sensor housing²⁾

Stainless steel 1.4404 (AISI 316L), 1.4301 (AISI 304), 1.4308 (ASTM CF8)

1) Hastelloy C is a registered trademark of Haynes International. C4 and C22 nickel alloys are equivalent to Hastelloy C4 and Hastelloy C22.

2) If the wetted parts of the sensor are made from nickel alloy then parts of the sensor housing are also manufactured from nickel alloy. However, the prevailing parts remain manufactured from the specified material.

Material load for process connections

Design	Nominal diameter	PS _{max}	TS _{max}	TS _{min}
Pipe fitting (DIN 11851)	DN 15 ... 40 (1/2 ... 1 1/2")	40 bar (580 psi)	140 °C (284 °F)	-40 °C (-40 °F)
	DN 50 ... 100 (2 ... 4")	25 bar (363 psi)	140 °C (284 °F)	-40 °C (-40 °F)
Pipe fitting (SMS 1145)	DN 25 ... 80 (1 ... 3")	6 bar (87 psi)	140 °C (284 °F)	-40 °C (-40 °F)
	DN 15 ... 50 (1/2 ... 2")	16 bar (232 psi)	120 °C (248 °F)	-40 °C (-40 °F)
Tri-Clamp (DIN 32676)	DN 65 ... 100 (2 1/2 ... 4")	10 bar (145 psi)	120 °C (248 °F)	-40 °C (-40 °F)

Material load curves for flange devices

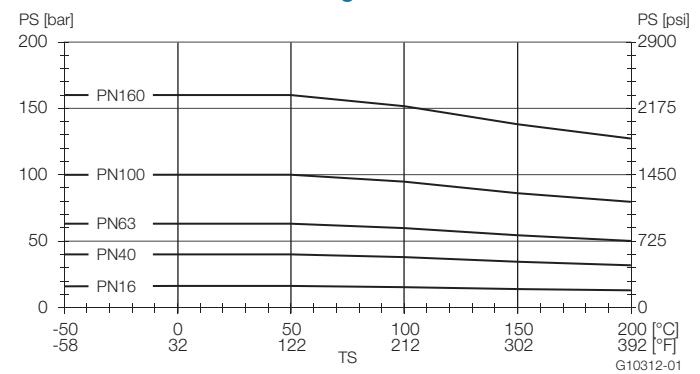


Fig. 11: Stainless steel DIN flange 1.4571 / 1.4404 (AISI 316Ti / 316L) up to DN 200 (8")

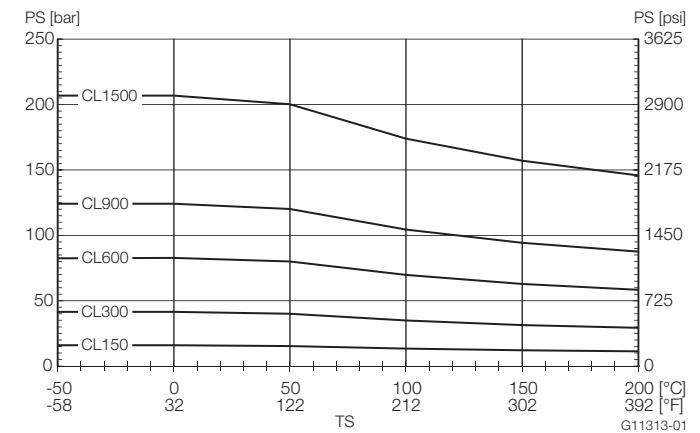


Fig. 12: Stainless steel ASME flange 1.4571 / 1.4404 (AISI 316Ti / 316L) up to DN 200 (8")

CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

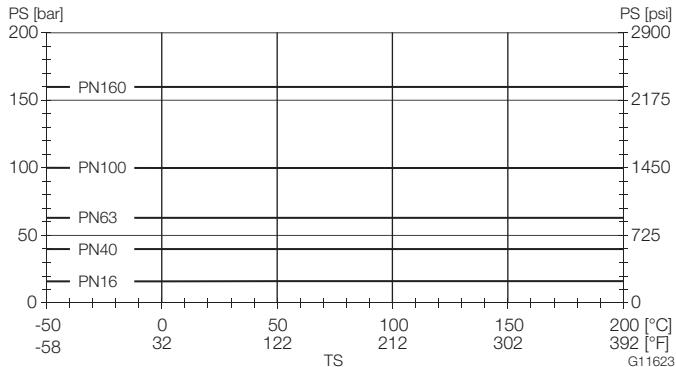


Fig. 13: Nickel alloy DIN flange C4 (2.4610) or nickel alloy C22 (2.4602) up to DN 200 (8")

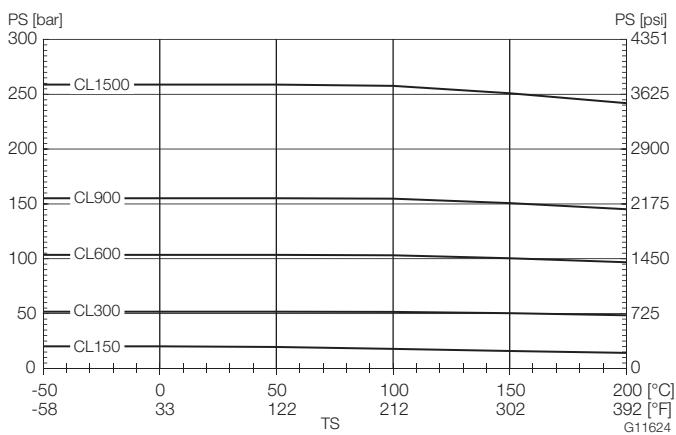


Fig. 14: Nickel alloy ASME flange C4 (2.4610) or nickel alloy C22 (2.4602) up to DN 200 (8")

Electrical connections

Models FCB130, FCB150, FCH130 and FCH150

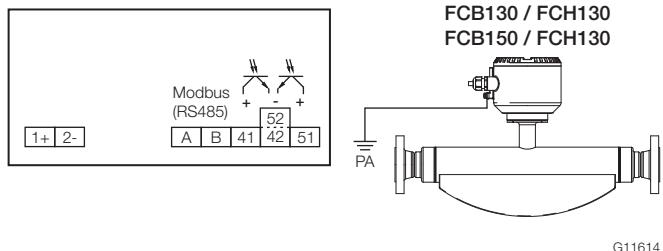


Fig. 15: Electrical connection

PA = Potential equalization

Connections for the power supply

DC voltage supply

Terminal	Function / comments
1+	+
2-	-

Connections for the outputs

Terminal

Function / comments

A / B	Modbus RTU (RS485)
41 / 42	Passive digital output DO1 The output can be configured as a pulse output, frequency output or switch output.
51 / 52	Passive digital output DO2 The output can be configured as a pulse output or switch output.

Electrical data for inputs and outputs

NOTICE

When using the device in potentially explosive atmospheres, note the additional connection information in the chapters entitled "Use in potentially explosive atmospheres according to ATEX and IECEx" on page 41 and "Use in potentially explosive atmospheres in accordance with cFMus" on page 47!

Power supply

Supply voltage	11 ... 30 V DC (ripple: $\leq 5\%$)
Power consumption	S ≤ 5 VA

Digital output 41 / 42, 51 / 52

Can be configured via Modbus.

NOTICE

- Digital output 51 / 52 **cannot** be configured as a frequency output.
- Terminals 42 / 52 have the same potential. Digital outputs 41 / 42 and 51 / 52 are not electrically isolated from each other.
- If you are using a mechanical counter, we recommend setting a pulse width of ≥ 30 ms and a maximum frequency of $f_{max} \leq 3$ kHz.

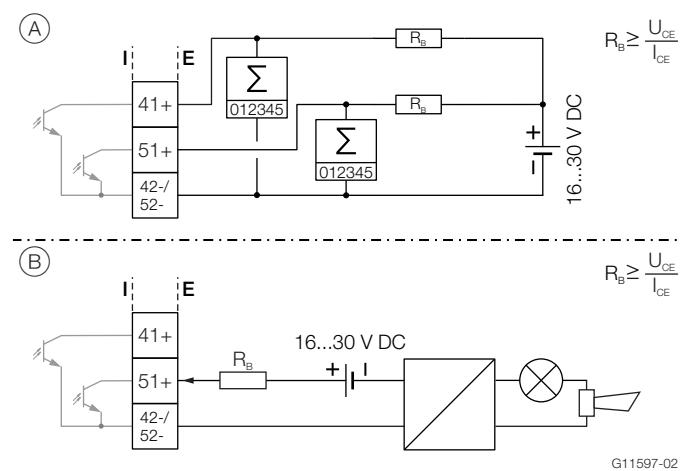


Fig. 16: Passive digital outputs (I = internal, E = external)
 (A) Passive digital output 41 / 42 as pulse or frequency output,
 Passive digital output 51 / 52 as pulse output (B) Passive digital output 51 / 52 as binary output

Pulse / frequency output (passive)

Terminals	41 / 42 (pulse / frequency output) 51 / 52 (pulse output)
Output "closed"	0 V $\leq U_{CEL} \leq 3$ V For $f < 2.5$ kHz: 2 mA $< I_{CEL} < 30$ mA For $f > 2.5$ kHz: 10 mA $< I_{CEL} < 30$ mA
Output "open"	16 V $\leq U_{CEH} \leq 30$ V DC 0 mA $\leq I_{CEH} \leq 0.2$ mA
f_{max}	10.5 kHz
Pulse width	0.1 ... 2000 ms

Binary output (passive)

Terminals	41 / 42, 51 / 52
Output "closed"	0 V $\leq U_{CEL} \leq 3$ V 2 mA $\leq I_{CEL} \leq 30$ mA
Output "open"	16 V $\leq U_{CEH} \leq 30$ V DC 0 mA $\leq I_{CEH} \leq 0.2$ mA
Switching function	Can be configured via Modbus. See chapter "Parameter descriptions" in the operating instruction.

When connecting the devices, note the voltage drop on the cable. The operating voltage on the device must not be less than 11 V.

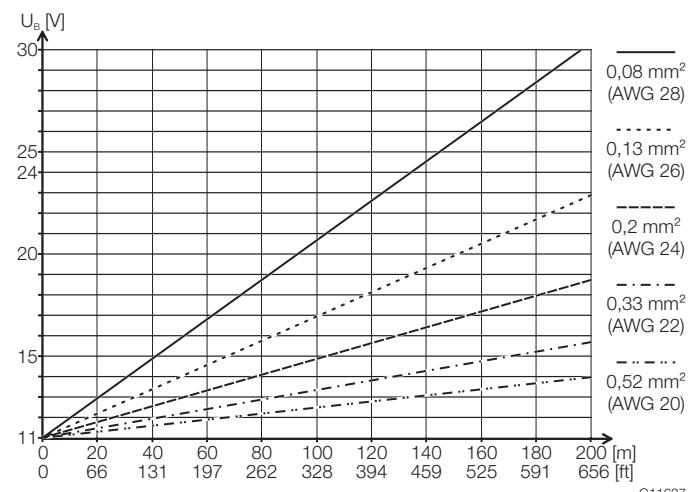


Fig. 17: Maximum cable lengths (examples)
 U_B = supply voltage, L = cable length

CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

Modbus protocol

Modbus is an open standard owned and administrated by an independent group of device manufacturers styled the Modbus Organization (www.modbus.org).

Using the Modbus protocol allows devices made by different manufacturers to exchange information via the same communication bus, without the need for any special interface devices to be used.

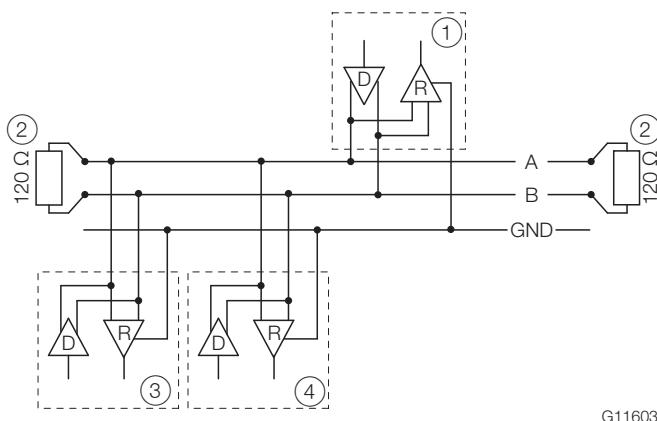


Fig. 18: Communication via the Modbus protocol

- ① Modbus master
- ② Terminating resistor
- ③ Modbus slave 1
- ④ Modbus slave n ... 32

Modbus protocol

Configuration	Via the Modbus interface or via the local operating interface in connection with Asset Vision Basic (DAT200) and a corresponding Device Type Manager (DTM)
Transmission	Modbus RTU - RS485 serial connection
Baud rate	2400, 4800, 9600, 19200, 38400, 56000, 57600, 115200 baud Factory setting: 9600 baud
Parity	None, even, odd Factory setting: odd
Stop bit	One, two Factory setting: One
IEEE format	Little endian, big endian Factory setting: Little endian
Typical response time	< 100 ms
Response delay time	0 ... 200 milliseconds Factory setting: 10 milliseconds

Cable specification

The maximum permissible length is dependent on the baud rate, the cable (diameter, capacity and surge impedance), the number of loads in the device chain, and the network configuration (2--core or 4-core).

- At a baud rate of 9600 and with a conductor cross section of at least 0.14 mm^2 (AWG 26), the maximum length is 1000 m (3280 ft).
- When using a 4-core cable as a 2-wire wiring system, the maximum length must be halved.
- The spur lines must be short, a maximum of 20 m (66 ft).
- When using a distributor with "n" connections, each branch must have a maximum length of 40 m (131 ft) divided by "n".

The maximum cable length depends on the type of cable used. The following standard values apply:

- Up to 6 m (20 ft):
cable with standard shielding or twisted-pair cable.
- Up to 300 m (984 ft):
double twisted-pair cable with overall foil shielding and integrated earth cable.
- Up to 1200 m (3937 ft):
double twisted-pair cable with individual foil shielding and integrated earth cables. Example: Belden 9729 or equivalent cable.

A category 5 cable can be used for Modbus RS485 up to a maximum length of 600 m (1968 ft). For the symmetrical pairs in RS485 systems, a surge impedance of more than 100Ω is preferred, especially at a baud rate of 19200 and above.

Dimensions

Meter tube inside diameter


Inner diameters of the meter tubes of Coriolis mass flowmeter CoriolisMaster FCB130, FCB150, FCH130, FCH150.

Nominal diameter	Inner diameter of the meter tube
DN 15 (1/2")	2 x 8 mm (2 x 0,31 inch)
DN 25 (1")	2 x 16 mm (2 x 0,63 inch)
DN 50 (2")	2 x 23,7 mm (2 x 0,93 inch)
DN 80 (3")	2 x 36,62 mm (2 x 1,44 inch)
DN 100 (4")	2 x 52,51 mm (2 x 2,07 inch)
DN 150 (6")	2 x 68,9 mm (2 x 2,71 inch)

Devices with meter tube nominal diameter DN 15 ... 50 and flange DN 10 ... 65

Sensor with wetted parts made from stainless steel. All specified dimensions and weights are in mm (inch) or kg (lb).

Standard Version

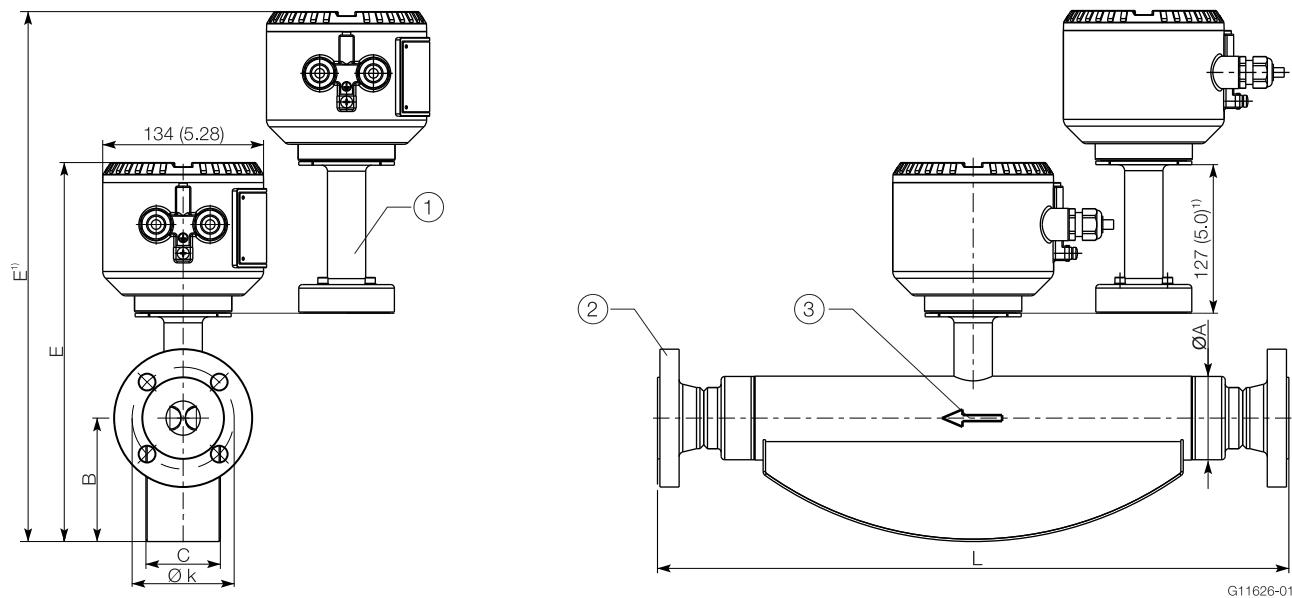

Marine version – CL1

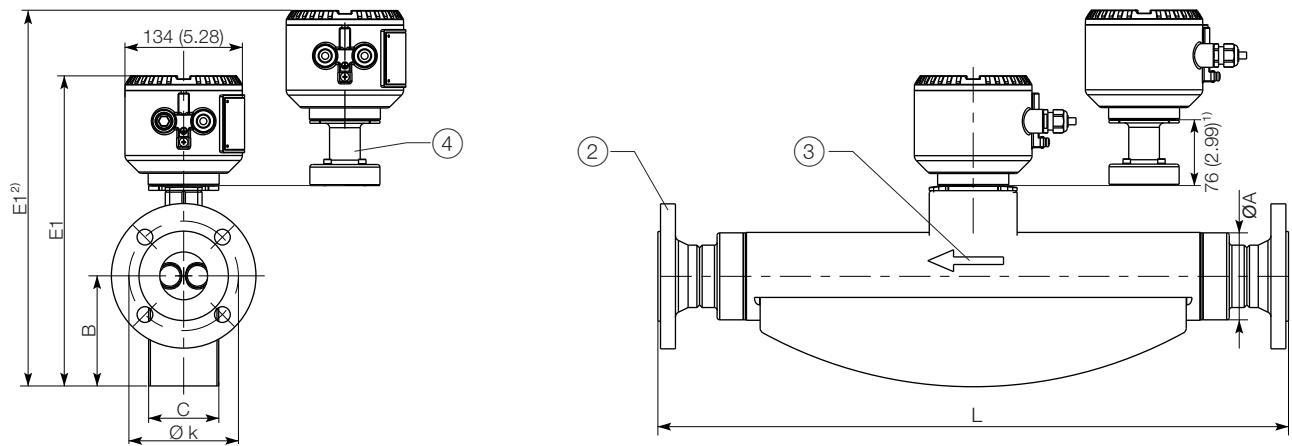


Fig. 19

- (1) "Extended tower length – TE1, TE2" or option "pressure rating of sensor secondary housing – PR5, PR6, PR7" option
- (2) Flange in accordance with EN 1092-1, ASME B16.5, ISO 7005 (connection dimensions for ASME flanges in accordance with ASME B16.5 (ANSI))
- (3) Flow direction
- (4) "Extended tower length - TE3" option

CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

Meter tube nominal diameter DN 15 (1/2")									
DN / process connection		L	Ø k	Ø A	B	C	E	E1	Weight max.
10 (3/8)	PN 40 (EN 1092-1 B1)	385 (15.2)	60 (2.4)	44.5 (1.8)	80 (3.2)	49 (1.93)	283 (11.1) 410 ¹⁾ (16.1 ¹⁾)	283 (11.1) 357 ²⁾ (14.1 ²⁾)	13 (28.7))
	JIS 10K	385 (15.2)	65 (2.6)						
15 (1/2)	PN 40 (EN 1092-1 B1)	385 (15.2)	65 (2.6)						
	PN 63 (EN 1092-1 B2)	403 (15.9)	75 (3.0)						
	PN 100 (EN 1092-1 B2)								
	CL150 (ASME B16.5)	435 (17.1)	60.5 (2.4)						
	CL300 (ASME B16.5)	421 (16.6)	66.5 (2.6)						
	CL600 (ASME B16.5)								
	CL900 (ASME B16.5)	421 (16.6)	82.6 (3.3)						
	CL1500 (ASME B16.5)								
20 (3/4)	JIS 10K	385 (15.2)	70 (2.8)						
	PN 40 (EN 1092-1 B1)	421 (16.6)	75 (3.0)						
	CL150 (ASME B16.5)	421 (16.6)	69.9 (2.8)						
Meter tube nominal diameter DN 25 (1")									
DN / process connection		L	Ø k	Ø A	B	C	E	E1	Weight max.
20 (3/4)	PN 40 (EN 1092-1 B1)	576 (22.7)	75 (3.0)	69.5 (2.74)	103 (4.06)	62 (2.44)	324 (12.8) 451 ¹⁾ (17.8 ¹⁾)	324 (12.8) 398 ²⁾ (15.7 ²⁾)	15 (33.1))
	CL150 (ASME B16.5)	575 (22.6)	69.9 (2.8)						
	JIS 10K	576 (22.7)	75 (3.0)						
25 (1)	PN 40 (EN 1092-1 B1)	525 (20.7)	85 (3.3)						
	PN 63 (EN 1092-1 B2)	564 (22.2)	100 (3.9)						
	PN 100 (EN 1092-1 B2)								
	CL150 (ASME B16.5)	575 (22.6)	79.2 (3.1)						
	CL300 (ASME B16.5)	576 (22.7)	88.9 (3.5)						
	CL600 (ASME B16.5)								
	CL900 (ASME B16.5)	576 (22.7)	101.6 (4.0)						
40 (1 1/2)	CL1500 (ASME B16.5)								
	JIS 10K	525 (20.7)	90 (3.54)						
	PN 40 (EN 1092-1 B1)	576 (22.7)	110 (4.33)						
	PN 63 (EN 1092-1 B2)	572 (22.5)	125 (4.92)						
	PN 100 (EN 1092-1 B2)								
	CL150 (ASME B16.5)	576 (22.7)	98.6 (3.88)						
1) Standard version: devices with "extended tower length – TE1, TE2" option or "pressure rating of sensor secondary housing" option. 2) Marine version – CL1: devices with "extended tower length – TE3" option									

Tolerance for dimension L: +0 / -3 mm (+0 / -0.018 inch)

Meter tube nominal diameter DN 50 (2")

DN / process connection	L	Ø K	Ø A	B	C	E	E1	Weight max.
40 (1 1/2)	PN 40 (EN 1092-1 B1)	763 (30)	110 (4.33)	99 (3.9)	126 (4.96)	80 (3.15)	354 (13.9) 481 ¹⁾ (18.94 ¹⁾)	354 (13.9) 428 ²⁾ (16.9 ²⁾)
	PN 63 (EN 1092-1 B2)	745 (29.33)	125 (4.92)					
	PN 100 (EN 1092-1 B2)							
	CL150 (ASME B16.5)	763 (30)	98.6 (3.88)					
	CL300 (ASME B16.5)	756 (29.76)	114.3 (4.5)					
	CL600 (ASME B16.5)							
	CL900 (ASME B16.5)	780 (30.71)	124 (4.88)					
50 (2)	CL1500 (ASME B16.5)							
	JIS 10K	763 (30)	105 (4.13)					
	PN 40 (EN 1092-1 B1)	715 (28.15)	125 (4.92)					
	PN 63 (EN 1092-1 B2)	745 (29.3)	135 (5.31)					
	PN 100 (EN 1092-1 B2)	745 (29.3)	145 (5.71)					
	CL150 (ASME B16.5)	715 (28.15)	120.7 (4.75)					
	CL300 (ASME B16.5)	763 (30)	127 (5.0)					
	CL600 (ASME B16.5)	773 (30.43)	127 (5.0)					
65 (2 1/2)	CL900 (ASME B16.5)	790 (31.1)	165.1 (6.5)					
	CL1500 (ASME B16.5)							
	JIS 10K	715 (28.15)	120 (4.72)					
	PN 40 (EN 1092-1 B1)	763 (30)	145 (5.71)					
	CL150 (ASME B16.5)	756 (29.8)	139.7 (5.5)					

1) Standard version: devices with "extended tower length – TE1, TE2" option or "pressure rating of sensor secondary housing" option.

2) Marine version – CL1: devices with "extended tower length – TE3" option

Tolerance for dimension L: +0 / -3 mm (+0 / -0.018 inch)


CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

Devices with meter tube nominal diameter DN 80 and flange DN 65 ... 100

Sensor with wetted parts made from stainless steel. All specified dimensions and weights are in mm (inch) or kg (lb).

Standard Version

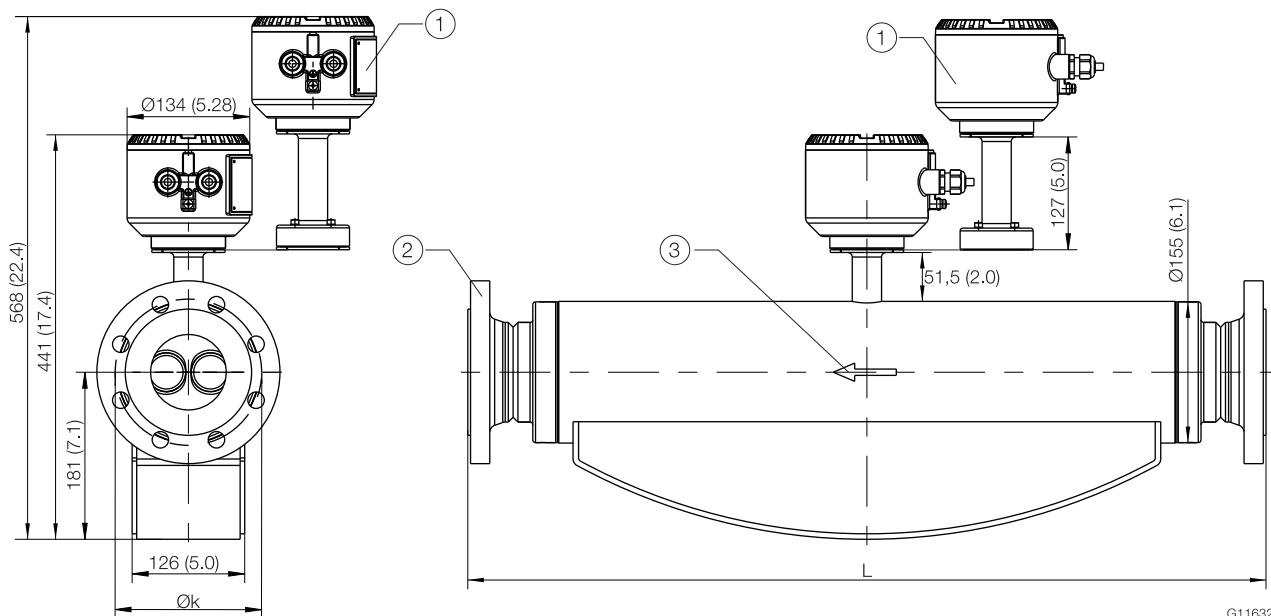

Marine version – CL1

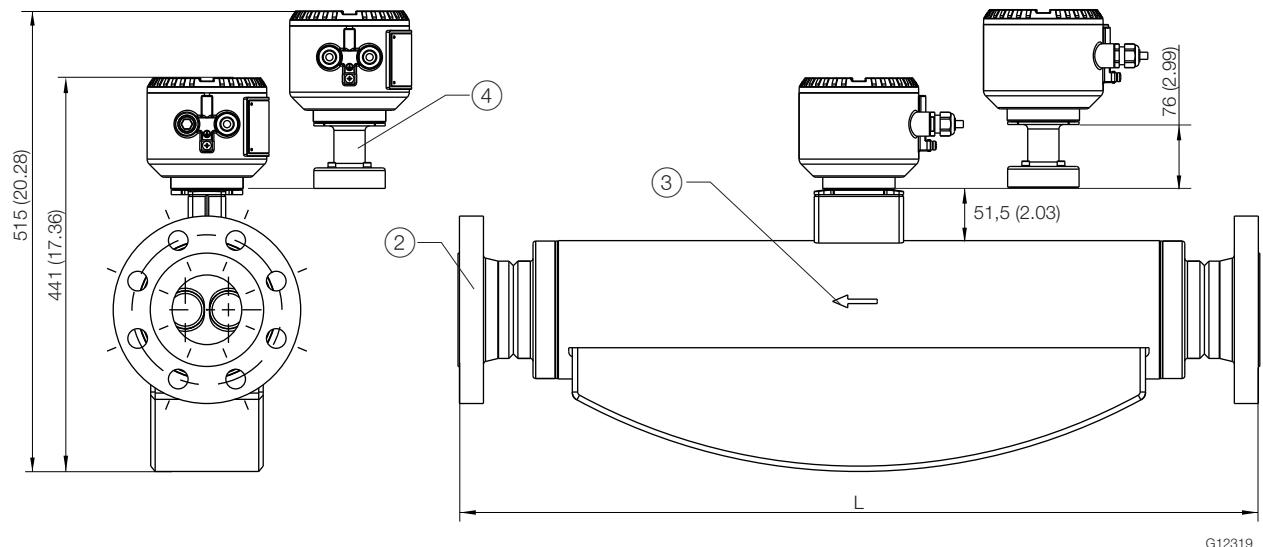


Fig. 20

- ① "Extended tower length – TE1, TE2" or option "pressure rating of sensor secondary housing – PR5, PR6, PR7" option
- ② Flange in accordance with EN 1092-1, ASME B16.5, ISO 7005 (connection dimensions for ASME flanges in accordance with ASME B16.5 (ANSI))
- ③ Flow direction
- ④ "Extended tower length - TE3" option

Meter tube nominal diameter DN 80 (3")			
DN / process connection	L	Ø k	Weight max.
65 (2 1/2")	PN 16 (EN 1092-1 B1) PN 40 (EN 1092-1 B1) PN 63 (EN 1092-1 B2) PN 100 (EN 1092-1 B2)	—1) 910 (35.83) 145 (5.71) 160 (6.3) 170 (6.69)	—1) 74 (163.1) 78 (172.0) 82 (180.8)
80 (3")	CL150 (ASME B16.5)	920 (36.22) 920 (36.22)	—1) 149.4 (5.88)
	CL300 (ASME B16.5)	920 (36.22)	76 (167.6)
	CL600 (ASME B16.5)		77 (169.8)
	CL900 (ASME B16.5)	965 (37.99)	190.5 (7.5) 94 (207.2)
	CL1500 (ASME B16.5)		
	JIS 10K	910 (35.83)	140 (5.5) 74 (163.1)
	PN 16 (EN 1092-1 B1)	870 (34.25)	160 (6.30) 74 (163.1)
	PN 40 (EN 1092-1 B1)		75 (165.4)
	PN 63 (EN 1092-1 B2)	910 (35.83)	170 (6.69) 180 (7.09) 79 (174.2) 85 (187.4)
100 (4")	PN 100 (EN 1092-1 B2)		
100 (4")	CL150 (ASME B16.5)	880 (34.65)	152.4 (6.00) 168.1 (6.62)
	CL300 (ASME B16.5)	895 (35.24)	79 (174.2)
	CL600 (ASME B16.5)	920 (36.22)	82 (180.8)
	CL900 (ASME B16.5)	1100 (43.31)	190.5 (7.50) 94 (207.2)
	CL1500 (ASME B16.5)	1300 (51.18)	203.2 (8.00) 106 (233.7)
	JIS 10K	870 (34.25)	150 (5.91) 75 (165.4)
	PN 16 (EN 1092-1 B1)	875 (34.45)	180 (7.09) 190 (7.48) 75 (165.4) 76 (167.5)
	PN 40 (EN 1092-1 B1)		
	PN 63 (EN 1092-1 B2)	1060 (41.73)	200 (7.87) 86 (189.6)
	PN 100 (EN 1092-1 B2)	1080 (42.52)	210 (8.27) 94 (207.2)

1) On request

Tolerance for dimension L: +0 / -3 mm (+0 / -0.018 inch)


CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

Devices with meter tube nominal diameter DN 100 and flange DN 80 ... 100

Sensor with wetted parts made from stainless steel. All specified dimensions and weights are in mm (inch) or kg (lb).

Standard Version

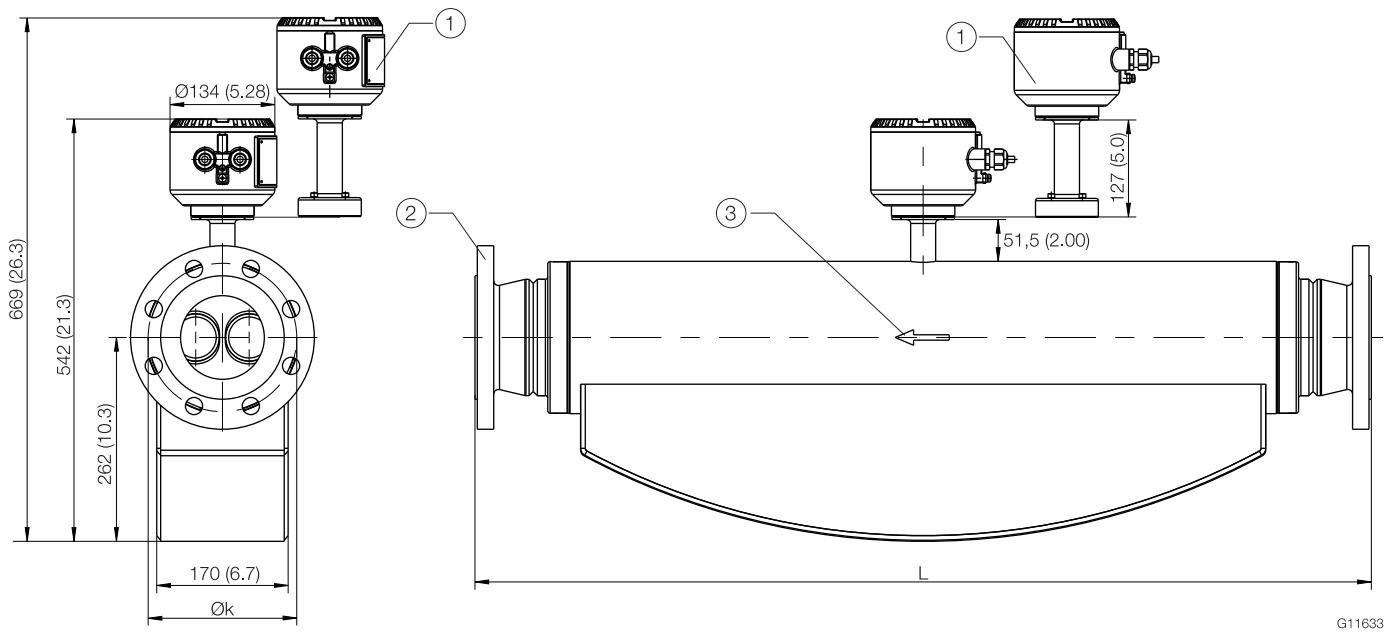

Marine version – CL1

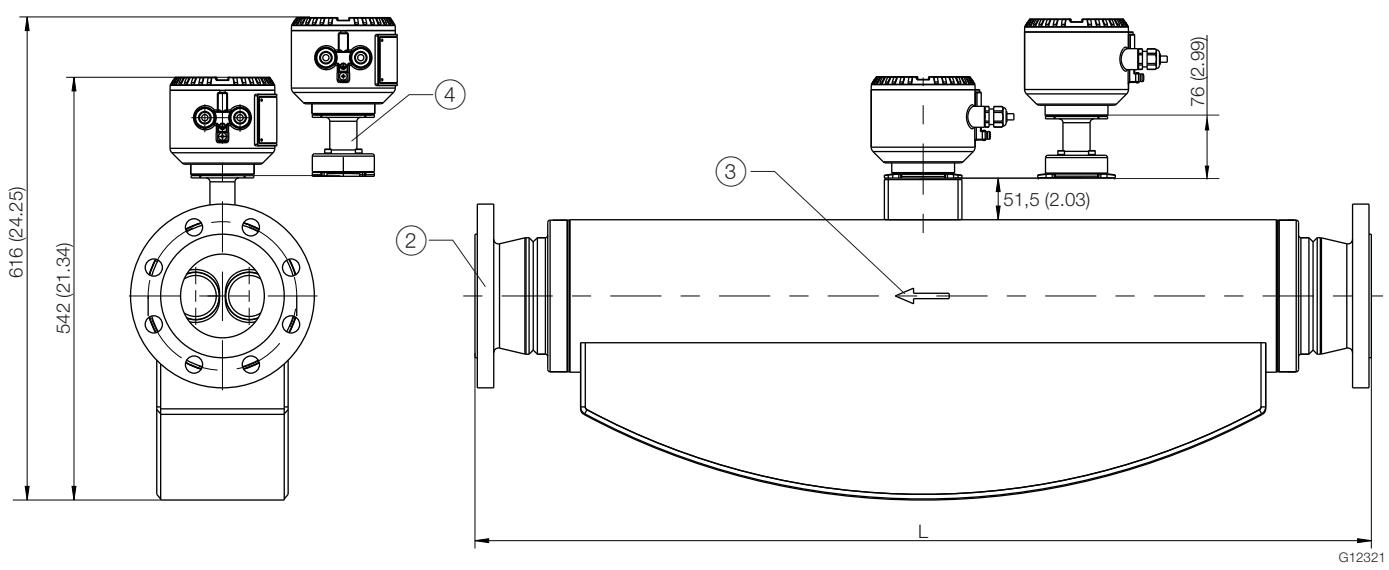


Fig. 21

(1) “Extended tower length – TE1, TE2” option or “pressure rating of sensor secondary housing – PR5, PR6, PR7” option (2) Flange in accordance with EN 1092-1, ASME B16.5, ISO 7005 (connection dimensions for ASME flanges in accordance with ASME B16.5 (ANSI)) (3) Flow direction (4) “Extended tower length - TE3” option

Meter tube nominal diameter DN 100 (4")

DN / process connection		L	Ø k	Weight max.
80 (3")	PN 16 (EN 1092-1 B1)	1222 (48.11)	160 (6.30)	126 (278)
	PN 40 (EN 1092-1 B1)			126 (278)
	PN 63 (EN 1092-1 B2)	1234 (48.58)	170 (6.69)	130 (287)
	PN 100 (EN 1092-1 B2)		180 (7.09)	132 (291)
	CL150 (ASME B16.5)	1244 (48.98)	152.4 (6.00)	127 (280)
	CL300 (ASME B16.5)		168.1 (6.62)	135 (298)
	CL600 (ASME B16.5)		168.1 (6.62)	138 (304)
	CL900 (ASME B16.5)	1470 (57.87)	190.5 (7.50)	141 (311)
	CL1500 (ASME B16.5)	1500 (59.05)	203.2 (8.00)	153 (337)
	JIS 10K	1275 (50.20)	150 (5.91)	123 (271)
100 (4")	PN 16 (EN 1092-1 B1)	1122 (44.17)	180 (7.09)	123 (271)
	PN 40 (EN 1092-1 B1)	1144 (45.04)	190 (7.48)	126 (278)
	PN 63 (EN 1092-1 B2)	1304 (51.34)	138 (5.43)	133 (293)
	PN 100 (EN 1092-1 B2)	1334 (52.52)	150 (5.91)	141 (311)
	CL150 (ASME B16.5)	1144 (45.04)	190.5 (7.50)	127 (280)
	CL300 (ASME B16.5)	1324 (52.13)	200.2 (7.88)	139 (306)
	CL600 (ASME B16.5)	1354 (53.31)	215.9 (8.50)	141 (311)
	CL900 (ASME B16.5)	1380 (54.33)	234.9 (9.25)	160 (353)
	CL1500 (ASME B16.5)	1400 (55.12)	241.3 (9.50)	174 (384)
	JIS 10K	1150 (45.28)	175 (6.89)	126 (278)
150 (6")	PN 16 (EN 1092-1 B1)	1300 (51.18)	240 (9.44)	131 (289)
	PN 40 (EN 1092-1 B1)	1330 (52.36)	250 (9.84)	139 (306)
	CL150 (ASME B16.5)		241.3 (9.50)	137 (302)
	JIS 10K		240 (9.44)	130 (287)

Tolerance for dimension L: +0 / -3 mm (+0 / -0.018 inch)


CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

Devices with meter tube nominal diameter DN 150 and flange DN 100 ... 200

Sensor with wetted parts made from stainless steel. All specified dimensions and weights are in mm (inch) or kg (lb).

Standard Version

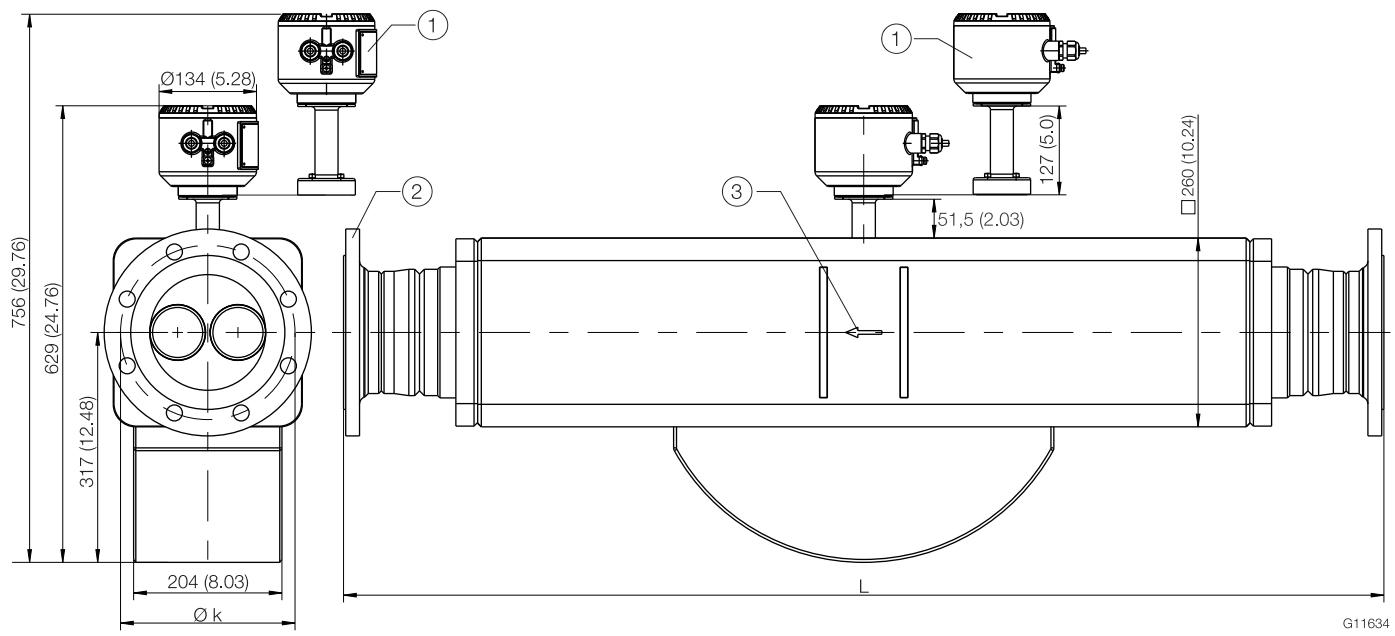

Marine version – CL1

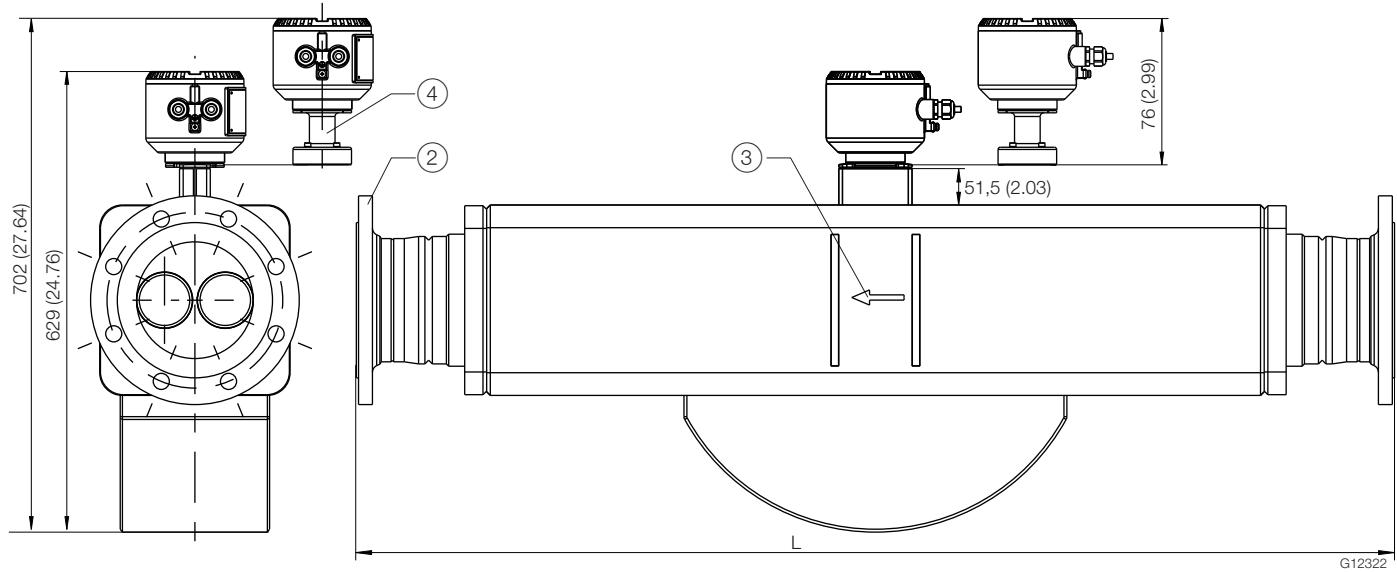


Fig. 22:

- ① “Extended tower length – TE1, TE2” or option “pressure rating of sensor secondary housing – PR5, PR6, PR7” option
- ② Flange in accordance with EN 1092-1, ASME B16.5, ISO 7005 (connection dimensions for ASME flanges in accordance with ASME B16.5 (ANSI))
- ③ Flow direction
- ④ “Extended tower length - TE3” option

Meter tube nominal diameter DN 150 (6")

DN / process connection	L	Ø k	Weight max.
100 (4")	PN 16 (EN 1092-1 B1)	1569 (61.77)	180 (7.09)
	PN 40 (EN 1092-1 B1)	1599 (62.95)	190 (7.48)
	CL150 (ASME B16.5)	1630 (64.17)	190.5 (7.50)
	CL300 (ASME B16.5)	1650 (64.96)	200.2 (7.88)
	CL600 (ASME B16.5)	1675 (65.94)	215.9 (8.50)
	CL900 (ASME B16.5)	1705 (67.13)	234.9 (9.25)
	CL1500 (ASME B16.5)	1725 (67.91)	241.3 (9.50)
150 (6")	PN 16 (EN 1092-1 B1)	1421 (55.94)	240 (9.45)
	PN 40 (EN 1092-1 B1)	1461 (57.52)	250 (9.84)
	CL150 (ASME B16.5)	1485 (58.46)	241.3 (9.50)
	CL300 (ASME B16.5)	1505 (59.25)	269.7 (10.62)
	CL600 (ASME B16.5)	1555 (61.22)	292.1 (11.50)
	CL900 (ASME B16.5)	1605 (63.19)	317.5 (12.5)
	CL1500 (ASME B16.5)	1665 (65.55)	249 (549) 291 (642)
200 (8")	PN 40 (EN 1092-1 B1)	1637 (64.45)	320 (12.6)
	CL150 (ASME B16.5)	1650 (64.96)	298.5 (11.75)
	CL300 (ASME B16.5)	1670 (65.75)	330.2 (13.0)
	JIS10K	1585 (62.4)	290 (11.42)
			209 (461) 204 (450) 229 (505) 195 (430)

Tolerance for dimension L: +0 / -3 mm (+0 / -0.018 inch)


CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

Devices DN 15 ... 150 in NAMUR standard installation lengths (order option S5, S7)

Sensor with wetted parts made from stainless steel. All specified dimensions and weights are in mm (inch) or kg (lb).

Standard Version

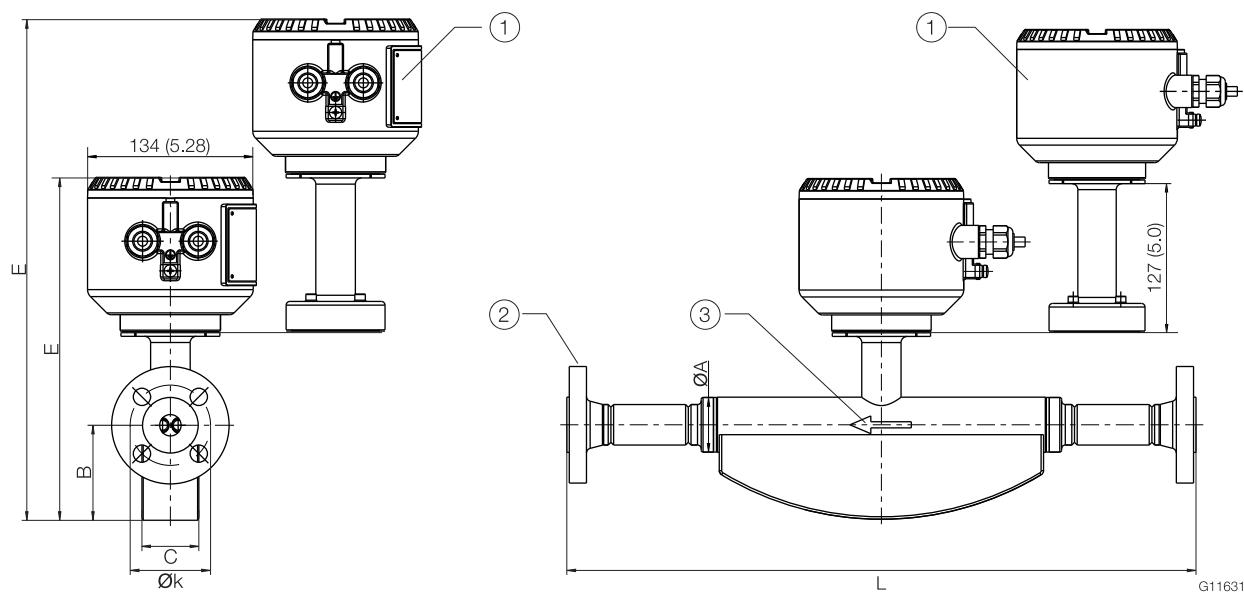

Marine version - CL1

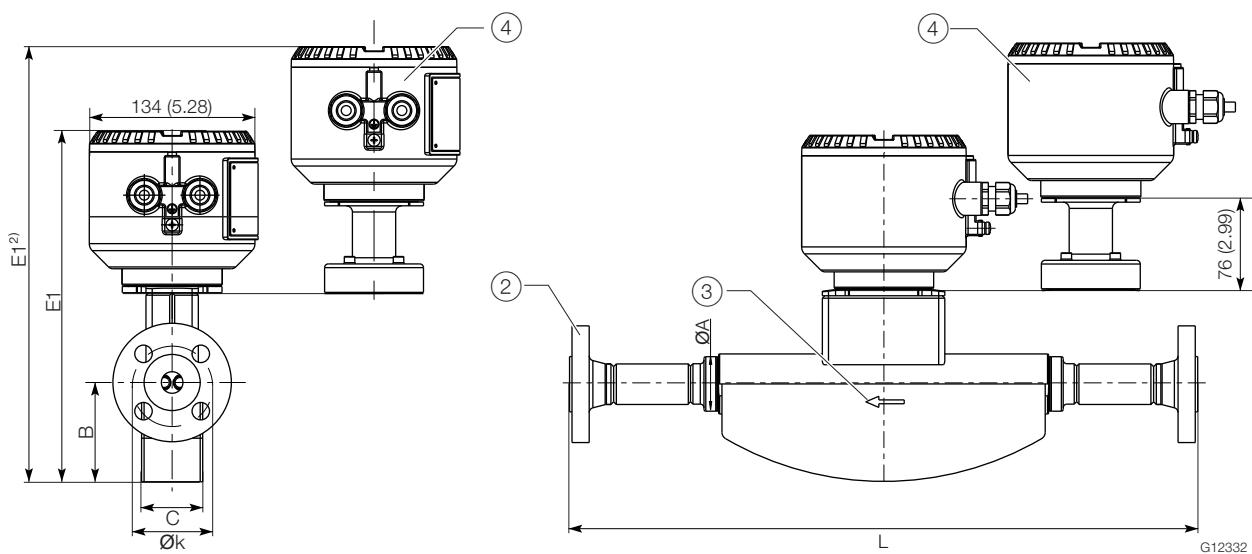


Fig. 23

- ① "Extended tower length - TE1, TE2" option or "pressure rating of sensor secondary housing - PR5, PR6, PR7" option
- ② Flange in accordance with EN 1092-1
- ③ Flow direction
- ④ "Extended tower length - TE3" option

Devices DN 15 ... 150 in NAMUR standard installation lengths

Meter tube	Process connection	L	Ø K	Ø A	B	C	E	E1	Approx. weight
EN 1092-1 B1									
DN 15 (1/2")	DN 15 (1/2") / PN 40	510 (20.08)	60 (2.4)	44.5 (1.8)	77 (3.0)	46 (1.8)	283 (11.1) 410 ¹⁾ (16.1 ¹⁾)	283 (11.1) 357 ²⁾ (14.1 ²⁾)	13.5 (29.8)
DN 25 (1")	DN 25 (1") / PN 40	600 (23.62)	75 (3.0)	69.5 (2.74)	103 (4.06)	62 (2.44)	324 (12.8) 451 ¹⁾ (17.8 ¹⁾)	324 (12.8) 398 ²⁾ (15.7 ²⁾)	15 (33.1)
DN 50 (1")	DN 50 (1") / PN 40	715 (28.15)	125 (4.92)	99 (3.9)	125 (4.92)	80 (3.15)	354 (13.9) 481 ¹⁾ (18.94 ¹⁾)	354 (13.9) 428 ²⁾ (16.9 ²⁾)	31 (68.3)
DN 80 (3")	DN 80 (3") / PN 40	915 (36.02)	160 (6.30)	155 (6.1)	183 (7.2)	123 (4.84)	445 (17.52) 572 ³⁾ (22.52 ³⁾)	—	74 (163)
DN 100 (4")	DN 100 (4") / PN 16	1400 (55.12)	180 (7.09)	195 (7.68)	261 (10.28)	168 (6.61)	541 (21.3) 668 ³⁾ (26.3 ³⁾)	—	123 (271)
DN 150 (6")	DN 150 (6") / PN 16	1700 (66.93)	240 (9.45)	260 (10.24)	320 (12.6)	205 (8.07)	630 (24.8) 757 ³⁾ (29.8 ³⁾)	—	178 (392)

1) Standard version: devices with "extended tower length – TE1, TE2" option or "pressure rating of sensor secondary housing" option.

2) Marine version – CL1: devices with "extended tower length – TE3" option


Tolerance for dimension L: +0 / -3 mm (+0 / -0.018 inch)

CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

Devices with meter tube nominal diameter DN 15 ... 80 and connections in accordance with SMS 1145, DIN 11851, DIN 32676, DIN ISO 228, ASME BPE and ASME B 1.20.1

Sensor with wetted parts made from stainless steel. All specified dimensions and weights are in mm (inch) or kg (lb).

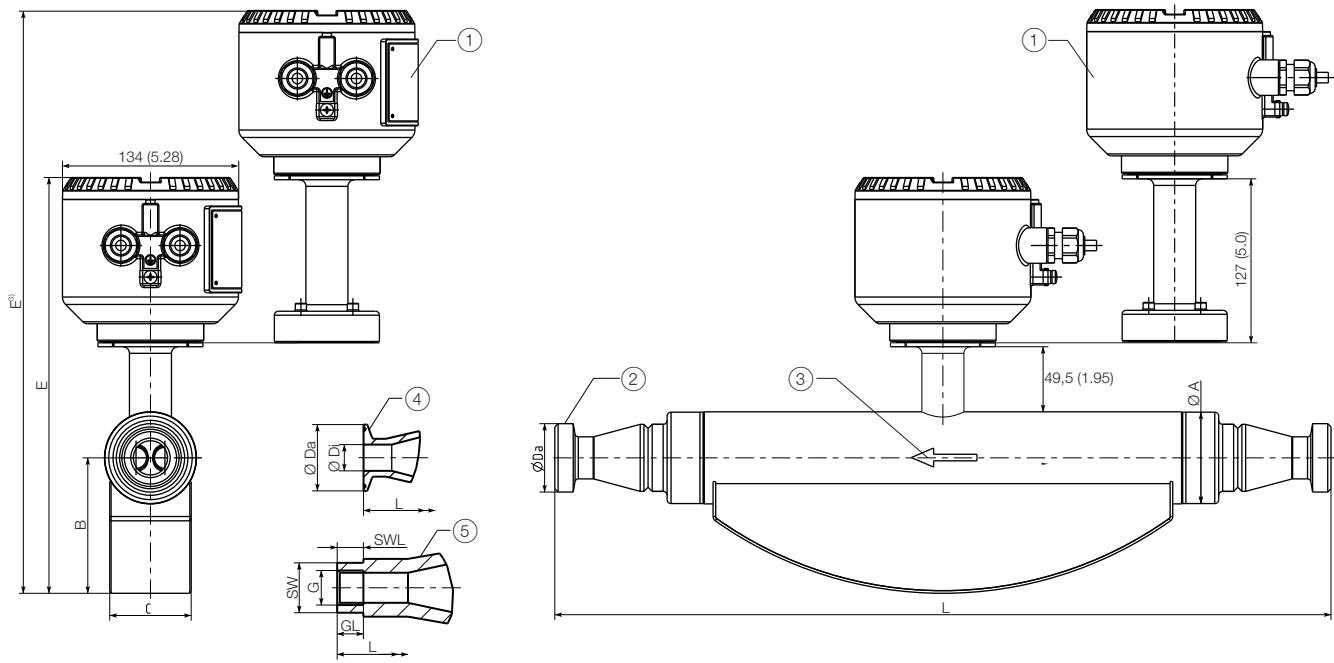

G11635

Fig. 24
 ① “Extended tower length – TE1, TE2” option or “pressure rating of sensor secondary housing – PR5, PR6, PR7” option ② threaded spud in accordance with DIN 11851 and SMS 1145 ③ Flow direction ④ Clamping connection in accordance with DIN 32676 and ASME BPE
 ⑤ Female thread connection in accordance with DIN ISO 228 and ASME B 1.20.1

Process connection in accordance with SMS 1145 meter tube nominal diameter DN 25 ... 80 (1" ... 3")

Meter tube	Process connection		L	Ø DA	Ø Di	Ø A	B	C	E	Approx. weight	
	DN	PN								Aluminum ¹⁾	Stainless steel ²⁾
25 (1")	25 (1")	6	590 (23.2)	RD 40x1/6"	22.6 (0.89)	69.5 (2.74)	103 (4.06)	62 (2.44)	317 / 444 ³⁾ (12.48 / 17.48 ³⁾)	11 / 12 ³⁾ (24 / 27 ³⁾)	14 / 15 ³⁾ (31 / 33 ³⁾)
	40 (1 1/2")			RD 60x1/6"	38 (1.50)						
50 (2")	40 (1 1/2")	6	763 (30.0)	RD 60x1/6"	35.5 (1.40)	99 (3.46)	125 (4.92)	80 (3.15)	354 / 481 ³⁾ (13.94 / 18.94 ³⁾)	27 / 28 ³⁾ (60 / 62 ³⁾)	30 / 31 ³⁾ (66 / 68 ³⁾)
	50 (2")			RD 70x1/6"	48.5 (1.91)						
	65 (2 1/2")			RD 85x1/6"	60.5 (2.38)						
80 (3")	65 (2 1/2")	6	990 (39.0)	RD 85x1/6"	60.5 (2.38)	155 (6.10)	183 (7.20)	123 (4.84)	445 / 572 ³⁾ (17.52 / 22.52 ³⁾)	68 / 69 ³⁾ (150 / 152 ³⁾)	71 / 72 ³⁾ (157 / 159 ³⁾)
	80 (3")			RD 98x1/4"	72.6 (2.86)						

Process connection in accordance with DIN 11851 meter tube nominal diameter DN 15 ... 80 (1/2" ... 3")

Meter tube DN	Process connection DN	PN	L	Ø DA	Ø Di	Ø A	B	C	E	Approx. weight	
										Aluminum ¹⁾	Stainless steel ²⁾
15 (1/2")	10 (3/8")	40	413 (16.3)	RD 28x1/8"	10 (0.39)	44.5 (1.75)	77 (3.03)	46 (1.81)	278 / 405 ³⁾ (10.94 / 15.94 ³⁾)	9 / 10 ³⁾ (20 / 22 ³⁾)	12 / 13 ³⁾ (27 / 29 ³⁾)
	15 (1/2")			RD 34x1/8"	16 (0.63)						
	20 (3/4")			RD 44x1/6"	20 (0.79)						
25 (1")	20 (3/4")	590 (23.2)		RD 44x1/6"	20 (0.79)	69.5 (2.74)	103 (4.06)	62 (2.44)	317 / 444 ³⁾ (12.48 / 17.48 ³⁾)	11 / 12 ³⁾ (24 / 27 ³⁾)	14 / 15 ³⁾ (31 / 33 ³⁾)
	25 (1")			RD 52x1/6"	26 (1.02)						
	40 (1 1/2")			RD 65x1/6"	38 (1.5)						
50 (2")	40 (1 1/2")	763 (30.0)		RD 65x1/6"	38 (1.5)	99 (3.46)	125 (4.92)	80 (3.15)	354 / 481 ³⁾ (13.94 / 18.94 ³⁾)	27 / 28 ³⁾ (60 / 62 ³⁾)	30 / 31 ³⁾ (66 / 68 ³⁾)
	50 (2")			RD 78x1/6"	50 (1.97)						
	65 (2 1/2")			RD 95x1/6"	66 (2.6)						
80 (3")	65 (2 1/2")	990 (39.0)		RD 95x1/6"	66 (2.6)	155 (6.10)	183 (7.20)	123 (4.84)	445 / 572 ³⁾ (17.52 / 22.52 ³⁾)	68 / 69 ³⁾ (150 / 152 ³⁾)	71 / 72 ³⁾ (157 / 159 ³⁾)
	80 (3")			RD 110x1/4"	81 (3.19)						
	100 (4")			RD 130x1/4"	100 (3.94)						

Process connection in accordance with DIN 32676 meter tube nominal diameter DN 15 ... 80 (1/2" ... 3")

Meter tube DN	Process connection DN	PN	L	Ø DA	Ø Di	Ø A	B	C	E	Approx. weight	
										Aluminum ¹⁾	Stainless steel ²⁾
15 (1/2")	10 (3/8")	40	413 (16.3)	34 (1.34)	10 (0.39)	44.5 (1.75)	77 (3.03)	46 (1.81)	278 / 405 ³⁾ (10.94 / 15.94 ³⁾)	9 / 10 ³⁾ (20 / 22 ³⁾)	12 / 13 ³⁾ (27 / 29 ³⁾)
	15 (1/2")				16 (0.63)						
	20 (3/4")				20 (0.79)						
25 (1")	20 (3/4")	590 (23.2)		50.5 (1.99)	20 (0.79)	69.5 (2.74)	103 (4.06)	62 (2.44)	317 / 444 ³⁾ (12.48 / 17.48 ³⁾)	11 / 12 ³⁾ (24 / 27 ³⁾)	14 / 15 ³⁾ (31 / 33 ³⁾)
	25 (1")				26 (1.02)						
	40 (1 1/2")				38 (1.5)						
50 (2")	40 (1 1/2")	763 (30.0)			38 (1.5)	99 (3.46)	125 (4.92)	80 (3.15)	354 / 481 ³⁾ (13.94 / 18.94 ³⁾)	27 / 28 ³⁾ (60 / 62 ³⁾)	30 / 31 ³⁾ (66 / 68 ³⁾)
	50 (2")				64 (2.52)						
	65 (2 1/2")				91 (3.58)						
80 (3")	65 (2 1/2")	10	950 (37.4)		66 (2.6)	155 (6.10)	183 (7.20)	123 (4.84)	445 / 572 ³⁾ (17.52 / 22.52 ³⁾)	68 / 69 ³⁾ (150 / 152 ³⁾)	71 / 72 ³⁾ (157 / 159 ³⁾)
	80 (3")				106 (4.17)						
	100 (4")				119 (4.69)						

1) Devices with terminal boxes made from aluminum.

2) Devices with terminal boxes made from stainless steel.

3) Devices with "extended tower length" option or "pressure rating of sensor secondary housing" option.

Tolerance for dimension L: +0 / -3 mm (+0 / -0.018 inch)

CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

Dimensions for sensors featuring meter tubes with nominal diameter DN 15 ... 80 (1/2" ... 3") and process connection in accordance with ASME BPE

Meter tube DN	Process connection DN	PN	L	Ø DA		Ø Di		Ø A	B	C	E	Approx. weight	
												Aluminum ¹⁾	Stainless steel ²⁾
15 (1/2")	3/8"-Type A	10	—	—	—	44.5 (1.75)	77 (3.03)	46 (1.81)	278 / 405 ³⁾ (10.94 / 15.94 ³⁾)	9 / 10 ³⁾ (20 / 22 ³⁾)	12 / 13 ³⁾ (27 / 29 ³⁾)		
	1/2"-Type A		433 (17.05)	25 (0.98)	9.4 (0.37)								
	3/4"-Type A		—	—	—								
25 (1")	3/4"-Type A		—	—	—	69.5 (2.74)	103 (4.06)	62 (2.44)	317 / 444 ³⁾ (12.48 / 17.48 ³⁾)	11 / 12 ³⁾ (24 / 27 ³⁾)	14 / 15 ³⁾ (31 / 33 ³⁾)		
	1"-Type B		590 (23.23)	50.4 (1.98)	22.1 (0.87)								
	1 1/2"-Type B		590 (23.23)	50.4 (1.98)	34.8 (1.37)								
50 (2")	1 1/2"-Type B		—	—	—	99 (3.46)	125 (4.92)	80 (3.15)	354 / 481 ³⁾ (13.94 / 18.94 ³⁾)	27 / 28 ³⁾ (60 / 62 ³⁾)	30 / 31 ³⁾ (66 / 68 ³⁾)		
	2"-Type B		740 (29.13)	63.9 (2.52)	47.5 (1.87)								
	2 1/2"-Type B		—	—	—								
80 (3")	2 1/2"-Type B		950 (37.40)	77.4 (3.05)	60.2 (2.37)	155 (6.10)	183 (7.20)	183 (7.20)	445 / 572 ³⁾ (17.52 / 22.52 ³⁾)	68 / 69 ³⁾ (150 / 152 ³⁾)	71 / 72 ³⁾ (157 / 159 ³⁾)		
	3"-Type B		910 (35.83)	90.9 (3.19)	72.9 (2.87)								
	4"-Type B		910 (35.83)	118.9 (4.68)	97.4 (3.83)								

Process connection in accordance with DIN ISO 228 and ASME B 1.20.1, meter tube nominal diameter DN 15 ... 80 (1/2" ... 3")

Meter tube DN	Process connection DN / G	PN	L	GL ⁴⁾		WS ⁵⁾	SWL ⁵⁾	Ø A	B	C	E	Approx. weight	
												Aluminum ¹⁾	Stainless steel ²⁾
15 (1/2")	8 (1/4") / G 1/4"	100	450 (17.72)	10 (0.39)	19	10 (0.39)	44.5 (1.75)	77 (3.03)	46 (1.81)	278 / 405 ³⁾ (10.94 / 15.94 ³⁾)	9 / 10 ³⁾ (20 / 22 ³⁾)	12 / 13 ³⁾ (27 / 29 ³⁾)	
	15 (1/2") / G 1/2"			13.5 (0.53)	27								
	25 (1") / G 1"			490 (19.29)	17								
	15 (1/2") / 1/2" NPT			450 (17.72)	15.6 (0.61)								

1) Devices with terminal boxes made from aluminum.

2) Devices with terminal boxes made from stainless steel.

3) Devices with "extended tower length" option or "pressure rating of sensor secondary housing" option.

4) Dimension GL: Provide thread length of female thread.

5) Dimension SW: Provide width across flats in mm, Dimension SWL: Provide length of wrench flats in mm.

Tolerance for dimension L: +0 / -3 mm (+0 / -0.018 inch)

Sensor with wetted parts made from C4 or C22 nickel alloy

For devices with wetted parts made from C4 or C22 nickel alloy, the installation length (L) is different from previous tables. All other dimensions and the weight are unchanged. All dimensions specified in mm (inch).

Dimensions for sensors with process connection in accordance with EN 1092-1 and ASME B16.5 (ANSI)

Meter tube nominal diameter	Process connection	L							JIS 10K
		EN 1092-1 B1 PN 16	EN 1092-1 B1 PN 40	EN 1092-1 B2 PN 63	EN 1092-1 B2 PN 100	ASME CL CL150	CL300	CL600	
DN 15 (1/2")	DN 10 (1/4")	—	449 (17.7)	449 (17.7)	449 (17.7)	—	—	—	449 (17.7)
	DN 15 (1/2")	—	442 (17.4)	442 (17.4)	442 (17.4)	442 (17.4)	442 (17.4)	442 (17.4)	442 (17.4)
	DN 20 (3/4")	—	428 (16.9)	428 (16.9)	428 (16.9)	428 (16.9)	428 (16.9)	428 (16.9)	428 (16.9)
DN 25 (1")	DN 20 (3/4")	—	646 (25.4)	646 (25.4)	646 (25.4)	646 (25.4)	646 (25.4)	646 (25.4)	646 (25.4)
	DN 25 (1")	—	614 (24.2)	614 (24.2)	614 (24.2)	614 (24.2)	614 (24.2)	614 (24.2)	614 (24.2)
	DN 40 (1 1/2")	—	576 (22.7)	576 (22.7)	576 (22.7)	576 (22.7)	576 (22.7)	576 (22.7)	576 (22.7)
DN 50 (2")	DN 40 (1 1/2")	—	814 (32.0)	814 (32.0)	814 (32.0)	814 (32.0)	814 (32.0)	814 (32.0)	814 (32.0)
	DN 50 (2")	—	764 (30.1)	764 (30.1)	764 (30.1)	764 (30.1)	764 (30.1)	764 (30.1)	764 (30.1)
	DN 65 (2 1/2")	—	819 (32.2)	819 (32.2)	819 (32.2)	792 (31.2)	792 (31.2)	792 (31.2)	819 (32.2)
DN 80 (3")	DN 65 (2 1/2")	—	1021 (40.2)	1021 (40.2)	1021 (40.2)	1021 (40.2)	1021 (40.2)	1021 (40.2)	1021 (40.2)
	DN 80 (3")	—	971 (38.2)	—	971 (38.2)	971 (38.2)	971 (38.2)	971 (38.2)	971 (38.2)
	DN 100 (4")	971 (38.2)	971 (38.2)	971 (38.2)	971 (38.2)	971 (38.2)	971 (38.2)	971 (38.2)	971 (38.2)
DN 100 (4")	DN 80 (3")	1357 (53.4)	1357 (53.4)	1357 (53.4)	1357 (53.4)	1357 (53.4)	1357 (53.4)	1357 (53.4)	1357 (53.4)
	DN 100 (4")	1280 (50.4)	1280 (50.4)	1280 (50.4)	1280 (50.4)	1280 (50.4)	1280 (50.4)	1280 (50.4)	1280 (50.4)
	DN 150 (6")	1261 (49.6)	1261 (49.6)	1261 (49.6)	1261 (49.6)	1261 (49.6)	1261 (49.6)	1261 (49.6)	1261 (49.6)
DN 150 (6")	DN 100 (4")	1592 (62.7)	1592 (62.7)	1632 (64.3)	1632 (64.3)	1592 (62.7)	1632 (64.3)	1632 (64.3)	1592 (62.7)
	DN 150 (6")	1502 (59.1)	1502 (59.1)	1542 (60.7)	1542 (60.7)	1502 (59.1)	1542 (60.7)	1542 (60.7)	1502 (59.1)

L dimension tolerance:

- Meter tube nominal diameter DN 15 ... 50 (1/2" ... 2"): +0 / -3 mm (+0 / -0.018 inch)
- Meter tube nominal diameter DN 80 (3"): +0 / -5 mm (+0 / -0.2 inch)
- Meter tube nominal diameter DN 100 ... 150 (4" ... 6"): +0 / -8 mm (+0 / -0.31 inch)

CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

Ordering information

NOTICE

For dependancies and limitations please check the online Product Selection Assistant at www.abb.com/flow-selector.

Main ordering information CoriolisMaster FCB130, FCB150

Base model

CoriolisMaster FCB130 Coriolis Mass Flowmeter	FCB130	XX	XX	XXXXX	XX	XX	X	X	XX	XX	X
CoriolisMaster FCB150 Coriolis Mass Flowmeter	FCB150	XX	XX	XXXXX	XX	XX	X	X	XX	XX	X

Explosion Protection Certification

General Purpose	Y0	Continued see next page
ATEX / IECEx, (Zone 2 / 22)	A2	
ATEX / IECEx, (Zone 1 / 21)	A1	
cFMus version Class 1 Div. 2 (Zone 2 / 21)	F2	
cFMus version Class 1 Div. 1 (Zone 1 / 21)	F1	

Connection Design / Connection Box Material / Cable Glands

Integral, defined by Transmitter housing	Y0
------------------------------------------	----

Meter Size / Connection Size

DN 15 (1/2 in.) / DN 10 (1/4 in.)	015E1
DN 15 (1/2 in.) / DN 15 (1/2 in.)	015R0
DN 15 (1/2 in.) / DN 20 (3/4 in.)	015R1
DN 25 (1 in.) / DN 20 (3/4 in.)	025E1
DN 25 (1 in.) / DN 25 (1 in.)	025R0
DN 25 (1 in.) / DN 40 (1-1/2 in.)	025R2
DN 50 (2 in.) / DN 40 (1-1/2 in.)	050E1
DN 50 (2 in.) / DN 50 (2 in.)	050R0
DN 50 (2 in.) / DN 65 (2-1/2 in.)	050R1
DN 80 (3 in.) / DN 65 (2-1/2 in.)	080E1
DN 80 (3 in.) / DN 80 (3 in.)	080R0
DN 80 (3 in.) / DN 100 (4 in.)	080R1
DN 100 (4 in.) / DN 80 (3 in.)	100E1
DN 100 (4 in.) / DN 100 (4 in.)	100R0
DN 100 (4 in.) / DN 150 (6 in.)	100R2
DN 150 (6 in.) / DN 100 (4 in.)	150E2
DN 150 (6 in.) / DN 150 (6 in.)	150R0
DN 150 (6 in.) / DN 200 (8 in.)	150R2

Main ordering information

CoriolisMaster FCB130 Coriolis Mass Flowmeter	XX	XX	X	X	XX	XX	X
CoriolisMaster FCB150 Coriolis Mass Flowmeter	XX	XX	X	X	XX	XX	X

Process Connection Type

Flanges DIN PN 16	D2	Continued see next page
Flanges DIN PN 40	D4	
Flanges DIN PN 63	D5	
Flanges DIN PN 100	D6	
Flanges EN 1092-1 PN 40, NAMUR length (DN 15: 510 mm, DN 25: 600 mm, DN 50: 715 mm)	S5	
Flanges with groove PN40 EN1092-10-D	S6	
Flanges EN 1092-1 PN 16, NAMUR length (DN 15: 510 mm, DN 25: 600 mm, DN 50: 715 mm)	S7	
Flanges ANSI / ASME B16.5 Class 150	A1	
Flanges ANSI / ASME B16.5 Class 300	A3	
Flanges ANSI / ASME B16.5 Class 600	A6	
Flanges ANSI / ASME B16.5 Class 900 (p-t rating Cl 600)	A7	
Flanges ANSI / ASME B16.5 Class 1500 (p-t rating Cl 600)	A8	
Flanges JIS 10K	J1	
Flanges JIS 20K	J3	
Threaded hygienic connection SMS1145, for pipe according to DIN11866 series A	K1	
Tri-Clamp acc. DIN 32676	T1	
Tri-Clamp acc. BPE	T3	
Food industry fittings acc. DIN 11851	F1	
Female NPT thread	N5	
Female G thread	M5	
Others	Z9	

Material of Wetted Parts

Stainless steel	A1
Ni-Alloy	1) C1

Flow Calibration

Flow forward +/- 0.40 % of flow rate, Gas 1 % of flow rate	2)	A
Flow forward +/- 0.25 % of flow rate, Gas 1 % of flow rate	2)	B
Flow forward +/- 0.15 % of flow rate, Gas 0.,5 % of flow rate	3)	C
Flow forward +/- 0.10 % of flow rate, Gas 0.5 % of flow rate	3)	D
Flow forward +/- 0.20 % of flow rate, Gas 1 % of flow rate	2)	E
Flow forward / reverse +/- 0.40 % of flow rate, Gas 1 % of flow rate	2)	J
Flow forward / reverse +/- 0.25 % of flow rate, Gas 1 % of flow rate	2)	K
Flow forward / reverse +/- 0.15 % of flow rate, Gas 0.5 % of flow rate	3)	L
Flow forward / reverse +/- 0.10 % of flow rate, Gas 0.5 % of flow rate	3)	M
Flow forward / reverse +/- 0.20 % of flow rate, Gas 1 % of flow rate	2)	N
Others		Z

Density Calibration

Density 10 g/l	2)	1
Density 2 g/l	3)	3
Density 1 g/l	3)	4
Density 0.5 g/l	3)	5
Others		9

CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

Main ordering information

CoriolisMaster FCB130 Coriolis Mass Flowmeter	XX	XX	X
CoriolisMaster FCB150 Coriolis Mass Flowmeter	XX	XX	X
Connection Design / Transmitter Housing Type / Transmitter Housing Material / Cable Glands			
Integral / Single compartment / Aluminium / 2 x M20 x 1.5	B1		
Integral / Single compartment / Aluminium / 2 x NPT 1/2 in.	B2		
Integral / Single compartment / Stainless Steel / 2 x M20 x 1.5	T1		
Integral / Single compartment / Stainless Steel / 2 x NPT 1/2 in.	T2		
Outputs			
MODBUS, 2 digital outputs (passive)			M2
Power Supply			
11 ... 30 V DC			C

Additional ordering information

CoriolisMaster FCB130 Coriolis Mass Flowmeter	XX	XXX	XXX	XX
CoriolisMaster FCB150 Coriolis Mass Flowmeter	XX	XXX	XXX	XX
Certificates				
Test report 2.2 acc. EN 10204 confirmation of material	C1			
Material monitoring with inspection certificate 3.1 acc. EN 10204	C2			
Material monitoring with inspection certificate 3.2 acc. EN 10204	C3			
Material monitoring NACE MR 01-75 with inspection certificate 3.1 acc. EN 10204	CN			
Declaration of compliance with the order 2.1 acc. EN 10204	C4			
Inspection certificate 3.1 acc. EN 10204 for visual, dimensional and functional test	C6			
Inspection certificate 3.1 acc. EN 10204 for positive material identification PMI (confirmation only)	CA			
Pressure test acc. AD2000	CB			
Test package (pressure test, non-destructive test, welder & welding procedure certificate)	CT			
Inspection certificate 3.1 acc. EN 10204 for NDE of welds	C8			
Certificate of accuracy 2.1 acc. EN 10204	CM			
Inspection certificate 3.1 acc. EN 10204 for positive material identification PMI (inclusive heat analysis)	CR			
Others	CZ			
Ships Register Certifications				
DNVGL			CL1	
Custody Transfer Certification				
Custody transfer acc. MID (OIML)	3)	CM1		
Special Operation Mode				
Standard + FillMass filling function	3)	N5		
Standard + DensiMass concentration measurement	3)	N6		
VeriMass - Meter verification				N7

Additional ordering information

CoriolisMaster FCB130 Coriolis Mass Flowmeter	XX	XXX	XX	XXX
CoriolisMaster FCB150 Coriolis Mass Flowmeter	XX	XXX	XX	XXX
Documentation Language				
German		M1		
English		M5		
Language package Western Europe / Scandinavia (Languages: DA, ES, FR, IT, NL, PT, FI, SV)		MW		
Language package Eastern Europe (Languages: EL, CS, ET, LV, LT, HU, HR, PL, SK, SL, RO, BG)		ME		
Others		MZ		
Pressure Rating of Sensor Secondary Containment				
Maximum burst pressure 6 MPa / 60 bar / 870 psi inclusive tower length extension		PR5		
Maximum burst pressure 10 MPa / 100 bar / 1450 psi inclusive tower length extension		PR6		
Maximum burst pressure 15 MPa / 150 bar / 2175 psi inclusive tower length extension		PR7		
Device Identification Plate				
Stainless steel plate with TAG no.		T1		
Others		TZ		
Extended Tower Length				
Tower length extension - meter insulation capability			TE1	
Tower length extension - meter insulation capability with double sealing			TE2	
Tower length extension -short- insulation capability			TE3	

- 1) If the sensor wetted parts are Ni-Alloy based, parts of the sensor housing are Ni-Alloy based too
- 2) Only with CoriolisMaster FCB130
- 3) Only with CoriolisMaster FCB150

Accessories

Description	Order no.
FCx1xx Local Operation Interface (LOI) Adapter and cable	3KXS310000L0001

CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

NOTICE

For dependancies and limitations please check the online Product Selection Assistant at www.abb.com/flow-selector.

Main ordering information CoriolisMaster FCH130, FCH150

Base model												
CoriolisMaster FCH130 Coriolis Mass Flowmeter	FCH130	XX	XX	XXXXX	XX	XX	X	X	XX	XX	X	
CoriolisMaster FCH150 Coriolis Mass Flowmeter	FCH150	XX	XX	XXXXX	XX	XX	X	X	XX	XX	X	
Explosion Protection Certification												
General Purpose							Y0					
ATEX / IECEx, (Zone 2 / 22)							A2					
ATEX / IECEx, (Zone 1 / 21)							A1					
cFMus version Class 1 Div. 2 (Zone 2 / 21)							F2					
cFMus version Class 1 Div. 1 (Zone 1 / 21)							F1					
Connection Design / Connection Box Material / Cable Glands												
Integral, defined by Transmitter housing							Y0					
Meter Size / Connection Size												
DN 25 (1 in.) / DN 20 (3/4 in.)								025E1				
DN 25 (1 in.) / DN 25 (1 in.)								025R0				
DN 25 (1 in.) / DN 40 (1-1/2 in.)								025R2				
DN 50 (2 in.) / DN 40 (1-1/2 in.)								050E1				
DN 50 (2 in.) / DN 50 (2 in.)								050R0				
DN 50 (2 in.) / DN 65 (2-1/2 in.)								050R1				
DN 80 (3 in.) / DN 65 (2-1/2 in.)								080E1				
DN 80 (3 in.) / DN 80 (3 in.)								080R0				
DN 80 (3 in.) / DN 100 (4 in.)								080R1				
Process Connection Type												
Tri-Clamp acc. DIN 32676									T1			
Tri-Clamp acc. ASME BPE									T3			
Food industry fittings acc. DIN 11851									F1			
Others									Z9			
Material of Wetted Parts												
Stainless steel, polished 1.4404 / 1.4435 (316L)									H2			

Continued see next page

Main ordering information

CoriolisMaster FCH130 Coriolis Mass Flowmeter	X	X	XX	XX	X
CoriolisMaster FCH150 Coriolis Mass Flowmeter	X	X	XX	XX	X

Flow Calibration

Flow forward +/- 0.40 % of flow rate, Gas 1 % of flow rate	1)	A
Flow forward +/- 0.25 % of flow rate, Gas 1 % of flow rate	1)	B
Flow forward +/- 0.15 % of flow rate, Gas 0.5 % of flow rate	2)	C
Flow forward +/- 0.10 % of flow rate, Gas 0.5 % of flow rate	2)	D
Flow forward +/- 0.20 % of flow rate, Gas 1 % of flow rate	1)	E
Flow forward / reverse +/- 0.40 % of flow rate, Gas 1 % of flow rate	1)	J
Flow forward / reverse +/- 0.25 % of flow rate, Gas 1 % of flow rate	1)	K
Flow forward / reverse +/- 0.15 % of flow rate, Gas 0.5 % of flow rate	2)	L
Flow forward / reverse +/- 0.10 % of flow rate, Gas 0.5 % of flow rate	2)	M
Flow forward / reverse +/- 0.20 % of flow rate, Gas 1 % of flow rate	1)	N
Others		Z

Density Calibration

Density 10 g/l	1)	1
Density 2 g/l	2)	3
Density 1 g/l	2)	4
Others		9

Connection Design / Transmitter Housing Type / Transmitter Housing Material / Cable Glands

Integral / Single compartment / Aluminium / 2 x M20 x 1.5	B1
Integral / Single compartment / Aluminium / 2 x NPT 1/2 in.	B2
Integral / Single compartment / Stainless Steel / 2 x M20 x 1.5	T1
Integral / Single compartment / Stainless Steel / 2 x NPT 1/2 in.	T2

Outputs

MODBUS, 2 digital outputs (passive)	M2
-------------------------------------	----

Power Supply

11 ... 30 V DC	C
----------------	---

CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

Additional ordering information

CoriolisMaster FCH130 Coriolis Mass Flowmeter	XX	XXX	XX	XX	XX	XXX
CoriolisMaster FCH150 Coriolis Mass Flowmeter	XX	XXX	XX	XX	XX	XXX
Certificates						
Test report 2.2 acc. EN 10204 confirmation of material	C1					
Material monitoring with inspection certificate 3.1 acc. EN 10204	C2					
Material monitoring with inspection certificate 3.2 acc. EN 10204	C3					
Material monitoring NACE MR 01-75 with inspection certificate 3.1 acc. EN 10204	CN					
Declaration of compliance with the order 2.1 acc. EN 10204	C4					
Inspection certificate 3.1 acc. EN 10204 for visual, dimensional and functional test	C6					
Inspection certificate 3.1 acc. EN 10204 for positive material identification PMI (confirmation only)	CA					
Pressure test acc. AD2000	CB					
Test package (pressure test, non-destructive test, welder & welding procedure certificate)	CT					
Inspection certificate 3.1 acc. EN 10204 for NDE of welds	C8					
Certificate of compliance for calibration 2.1 acc. EN 10204	CM					
Inspection certificate 3.1 acc. EN 10204 for positive material identification PMI (inclusive heat analysis)	CR					
Others	CZ					
Custody Transfer Certification						
Custody transfer acc. MID (OIML)			CM1			
Special Operation Mode						
Standard + FillMass filling function	2)	N5				
Standard + DensiMass concentration measurement	2)	N6				
VeriMass - Meter verification		N7				
Documentation Language						
German			M1			
English			M5			
Language package Western Europe / Scandinavia (Languages: DA, ES, FR, IT, NL, PT, FI, SV)			MW			
Language package Eastern Europe (Languages: EL, CS, ET, LV, LT, HU, HR, PL, SK, SL, RO, BG)			ME			
Others			MZ			
Device Identification Plate						
Stainless steel plate with TAG no.			T1			
Others			TZ			
Extended Tower Length						
Tower length extension - meter insulation capability						TE1
Tower length extension - meter insulation capability with double sealing						TE2
Tower length extension -short- insulation capability						TE3

- 1) Only with CoriolisMaster FCH130
 2) Only with CoriolisMaster FCH150

Accessories




Description	Order no.
FCx1xx Local Operation Interface (LOI) Adapter and cable	3KXS310000L0001

Use in potentially explosive atmospheres according to ATEX and IECEx

NOTICE

Further information on the approval of devices for use in potentially explosive atmospheres can be found in the type examination certificates or the relevant certificates at www.abb.com/flow.

Device overview

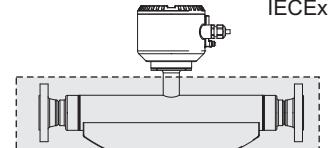	Standard / No explosion protection	Zone 2, 21, 22	Zone 1, 21 (Zone 0)
Model number	FCx1xx Y0	FCx1xx A2	FCx1xx A1
– Standard			
– Zone 2, 21, 22			
– Zone 1, 21			
– Zone 0			
			
	G11604a	G11604b	G11604c

Ex-marking

NOTICE

- Depending on the design, a specific marking in accordance with ATEX or IECEx applies.
- ABB reserves the right to modify the Ex-marking. Refer to the name plate for the exact marking.

Devices with a maximum ambient temperature T_{amb} . 55 °C (131 °F)

The Ex-marking stated in the following tables only apply to devices with a maximum permitted ambient temperature of T_{amb} . 55 °C (131 °F) (order code ambient temperature range TA8)!

Marking for model FCx1xx-A2... in Zone 2, 21, 22

ATEX	IECEx
FM 14 ATEX0017X	IECEx FME 14.0003X
II 3 G Ex nA mc IIC T6 ... T2 Gc	Ex nA mc IIC T6 ... T2 Gc
FM 14 ATEX0016X	Ex tb IIIC T85°C ... T _{medium} Db
II 2 D Ex tb IIIC T85°C ... T _{medium} Db	

Marking for model FCx1xx-A1 in Zone 1, 21 (Zone 0)

ATEX	IECEx
FM 14 ATEX0016X	IECEx FME 14.0003X
II 2/1 G Ex e ia mb IIC T5 ... T2 Ga/Gb $T_{amb,max} = 55^\circ\text{C}$	Ex e ia mb IIC T5 ... T2 Ga/Gb $T_{amb,max} = 55^\circ\text{C}$
II 2/1 G Ex e ia mb IIC T6 ... T2 Ga/Gb $T_{amb,max} = 50^\circ\text{C}$	Ex e ia mb IIC T6 ... T2 Ga/Gb $T_{amb,max} = 50^\circ\text{C}$
II 2 D Ex ia tb IIIC T85°C ... T _{medium} Db	Ex ia tb IIIC T85°C ... T _{medium} Db
Control Installation Drawing No. 3KXF000014G0009	Control Installation Drawing No. 3KXF000014G0009

CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

Devices with a maximum ambient temperature $T_{\text{amb.}}$ 70 °C (158 °F)

The Ex marking stated in the following tables only applies to devices with a maximum permissible ambient temperature of $T_{\text{amb.}}$ 70 °C (158 °F) (order code ambient temperature range TA3 / TA9)!

Marking for model FCx1xx-A2... in Zone 2, 21, 22

ATEX	IECEx
FM 14 ATEX0017X	IECEx FME 14.0003X
II 3 G Ex nA mc IIC T6 ... T2 Gc	Ex nA mc IIC T6 ... T2 Gc
FM 14 ATEX0016X	Ex tb IIIC T85°C ... T_{medium} Db
II 2 D Ex tb IIIC T85°C ... T_{medium} Db	

Marking for model FCx1xx-A1 in Zone 1, 21 (Zone 0)

ATEX	IECEx
FM 14 ATEX0016X	IECEx FME 14.0003X
II 2/1 G Ex e ia mb IIC T6 ... T2 Ga/Gb $T_{\text{amb.},\text{max}} = 70^\circ\text{C}$	Ex e ia mb IIC T6 ... T2 Ga/Gb $T_{\text{amb.},\text{max}} = 70^\circ\text{C}$
II 2 D Ex ia tb IIIC T85°C ... T_{medium} Db	Ex ia tb IIIC T85°C ... T_{medium} Db
Control Installation Drawing No. 3KXF000014G0009	Control Installation Drawing No. 3KXF000014G0009

Temperature data

Temperature resistance for the connecting cable

The temperature at the cable entries of the device is dependent on the measuring medium temperature T_{medium} and the ambient temperature $T_{\text{amb.}}$.

For the electrical connection of the device, only use cables with sufficient temperature resistance according to the following diagram or table.

Devices with a maximum ambient temperature $T_{\text{amb.}}$ 55 °C (131 °F)

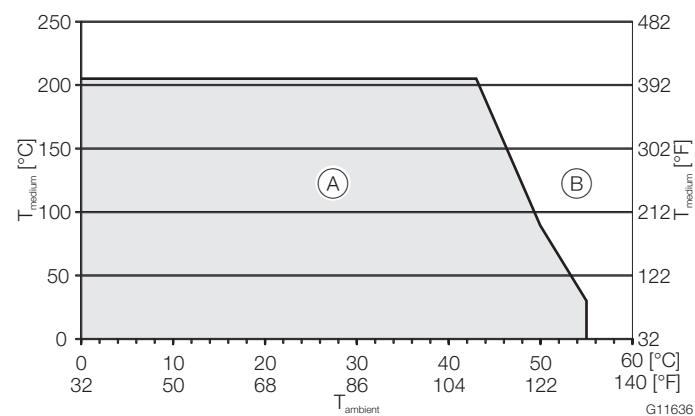


Fig. 25: Temperature range for the cable

- (A) Temperature resistance $\geq 70^\circ\text{C}$ (158 °F)
- (B) Temperature resistance $\geq 80^\circ\text{C}$ (176 °F)

Devices with a maximum ambient temperature $T_{\text{amb.}}$ 70 °C (158 °F)

$T_{\text{amb.}}$	Temperature resistance for the connecting cable
$\leq 50^\circ\text{C}$ ($\leq 122^\circ\text{F}$)	$\geq 70^\circ\text{C}$ ($\geq 158^\circ\text{F}$)
$\leq 60^\circ\text{C}$ ($\leq 140^\circ\text{F}$)	$\geq 80^\circ\text{C}$ ($\geq 176^\circ\text{F}$)
$\leq 70^\circ\text{C}$ ($\leq 158^\circ\text{F}$)	$\geq 90^\circ\text{C}$ ($\geq 194^\circ\text{F}$)

Above an ambient temperature of $T_{\text{amb.}} \geq 60^\circ\text{C}$ ($\geq 140^\circ\text{F}$), the wires in the connection box must be insulated with the enclosed silicone hoses.

Devices with a maximum ambient temperature $T_{\text{amb.}}$ 55 °C (131 °F)

The temperature data stated on this page only applies to devices with a maximum permitted ambient temperature of $T_{\text{amb.}}$ 55 °C (131 °F) (order code ambient temperature range TA8)!

Environmental and process conditions for model FCx1xx...

Ambient temperature		Measuring medium temperature	IP rating / NEMA rating
[$T_{\text{amb.}}$]	[$T_{\text{amb. optional}}$]	[T_{medium}]	
-20 ... 55 °C (-4 ... 131 °F)	-40 ... 55 °C (-40 ... 131 °F)	-40 ... 205 °C (-40 ... 400 °F)	IP 64, IP 65, IP 67, IP 68 and NEMA 4X / type 4X

Measuring medium temperature (Ex data) for model FCx1xx-A1... in Zone 1

Ambient temperature [$T_{\text{amb.}}$]	$\leq 50^{\circ}\text{C}$ ($\leq 122^{\circ}\text{F}$)	$\leq 55^{\circ}\text{C}$ ($\leq 131^{\circ}\text{F}$)
Temperature class	Maximum permissible measuring medium temperature [T_{medium}]	
T1	205 °C (400 °F)	205 °C (400 °F)
T2	205 °C (400 °F)	205 °C (400 °F)
T3	195 °C (383 °F)	195 °C (383 °F)
T4	130 °C (266 °F)	130 °C (266 °F)
T5	95 °C (203 °F)	95 °C (203 °F)
T6	80 °C (176 °F)	—

Measuring medium temperature (Ex data) for model FCx1xx-A2... in Zone 2

Ambient temperature [$T_{\text{amb.}}$]	$\leq 50^{\circ}\text{C}$ ($\leq 122^{\circ}\text{F}$)	$\leq 55^{\circ}\text{C}$ ($\leq 131^{\circ}\text{F}$)
Temperature class	Maximum permissible measuring medium temperature [T_{medium}]	
T1	205 °C (400 °F)	205 °C (400 °F)
T2	205 °C (400 °F)	205 °C (400 °F)
T3	195 °C (383 °F)	195 °C (383 °F)
T4	130 °C (266 °F)	130 °C (266 °F)
T5	95 °C (203 °F)	95 °C (203 °F)
T6	80 °C (176 °F)	80 °C (176 °F)

Measuring medium temperature (Ex data) for model FCx1xx-A1... in Zone 21 and FCx1xx-A2 ... in Zone 22

Ambient temperature [$T_{\text{amb.}}$]	$\leq 50^{\circ}\text{C}$ ($\leq 122^{\circ}\text{F}$)	$\leq 55^{\circ}\text{C}$ ($\leq 131^{\circ}\text{F}$)
Temperature class	Maximum permissible measuring medium temperature [T_{medium}]	
T210°C	205 °C (400 °F)	205 °C (400 °F)
T200°C	195 °C (383 °F)	195 °C (383 °F)
T135°C	130 °C (266 °F)	130 °C (266 °F)
T100°C	95 °C (203 °F)	95 °C (203 °F)
T85°C	80 °C (176 °F)	—

CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

Devices with a maximum ambient temperature $T_{\text{amb.}}$ 70 °C (158 °F)

The temperature data stated on this page only applies to devices with a maximum permitted ambient temperature of $T_{\text{amb.}}$ 70 °C (158 °F) (order code ambient temperature range TA3 / TA9)!

Environmental and process conditions for model FCx1xx...

Ambient temperature	Measuring medium temperature	IP rating / NEMA rating
[$T_{\text{amb.}}$]	[$T_{\text{amb. optional}}$]	[T_{medium}]
-20 ... 70 °C (-4 ... 158 °F)	-40 ... 70 °C (-40 ... 158 °F)	-40 ... 205 °C (-40 ... 400 °F)

IP 65, IP 67, IP 68 and NEMA 4X / type 4X

Measuring medium temperature (Ex data) for model FCx1xx-A1... in Zone 1

Ambient temperature [$T_{\text{amb.}}$]	≤ 30 °C (≤ 86 °F)	≤ 50 °C (≤ 122 °F)	≤ 60 °C (≤ 140 °F)	≤ 70 °C (≤ 158 °F)
Temperature class	Maximum permissible measuring medium temperature [T_{medium}]			
T1	205 °C (400 °F)	205 °C (400 °F)	205 °C (400 °F)	205 °C (400 °F)
T2	205 °C (400 °F)	205 °C (400 °F)	205 °C (400 °F)	205 °C (400 °F)
T3	195 °C (383 °F)	195 °C (383 °F)	195 °C (383 °F)	195 °C (383 °F)
T4	130 °C (266 °F)	130 °C (266 °F)	130 °C (266 °F)	130 °C (266 °F)
T5	95 °C (203 °F)	95 °C (203 °F)	95 °C (203 °F)	95 °C (203 °F)
T6	80 °C (176 °F)	80 °C (176 °F)	80 °C (176 °F)	—

Measuring medium temperature (Ex data) for model FCx1xx-A2... in Zone 2

Ambient temperature [$T_{\text{amb.}}$]	≤ 30 °C (≤ 86 °F)	≤ 50 °C (≤ 122 °F)	≤ 60 °C (≤ 140 °F)	≤ 70 °C (≤ 158 °F)
Temperature class	Maximum permissible measuring medium temperature [T_{medium}]			
T1	205 °C (400 °F)	205 °C (400 °F)	205 °C (400 °F)	205 °C (400 °F)
T2	205 °C (400 °F)	205 °C (400 °F)	205 °C (400 °F)	205 °C (400 °F)
T3	195 °C (383 °F)	195 °C (383 °F)	195 °C (383 °F)	195 °C (383 °F)
T4	130 °C (266 °F)	130 °C (266 °F)	130 °C (266 °F)	130 °C (266 °F)
T5	95 °C (203 °F)	95 °C (203 °F)	—	—
T6	80 °C (176 °F)	—	—	—

Measuring medium temperature (Ex data) for model FCx1xx-A1... in Zone 21 and FCx1xx-A2 ... in Zone 22

In zones 21 and 22, the surface temperature of the device corresponds to the measuring medium temperature of the device T_{medium} .

Electrical data

Modbus outputs and digital outputs

Devices with a maximum ambient temperature T_{amb} . 55 °C (131 °F)

The electrical data stated in the following tables only applies to devices with a maximum permitted ambient temperature of T_{amb} . 55 °C (131 °F) (order code ambient temperature rangeTA8)!

Model: FCx1xx-A1, FCx1xx-A2

Outputs	Operating values (general)		Type of protection									
			"nA" (zone 2)		"e" (zone 1)		"ia" (zone 1)		P_o [mW]	C_o [nF]	$C_{o PA}$ [nF]	L_o [mH]
Modbus, active Terminals A / B	U_N [V]	I_N [mA]	U_N [V]	I_N [mA]	U_M [V]	I_M [mA]	U_o [V]	I_o [mA]				
	3	30	3	30	30	30	4.2	150	150	0	0	0
							U_i [V]	I_i [mA]	P_i [mW]	C_i [nF]	$C_{i pa}$ [nF]	L_i [mH]
Digital output DO1, passive Terminals 41 / 42							± 4.2	150	150	0	0	0
	30	25	30	25	30	25	30	25	187	2.4	2.4	0.2
Digital output DO2, passive Terminals 51 / 52	30	25	30	25	30	25	30	25	187	10	0	0.2

All outputs are electrically isolated from each other and from the power supply.

Digital outputs DO1 / DO2 are not electrically isolated from each other. Terminals 42 / 52 have the same potential.

Devices with a maximum ambient temperature T_{amb} . 70 °C (158 °F)

The electrical data stated in the following tables only applies to devices with a maximum permitted ambient temperature of T_{amb} . 70 °C (158 °F) (order code ambient temperature rangeTA3 / TA9)!

Model: FCx1xx-A1, FCx1xx-A2

Outputs	Operating values (general)		Type of protection									
			"nA" (zone 2)		"e" (zone 1)		"ia" (zone 1)		P_o [mW]	C_o [nF]	$C_{o PA}$ [nF]	L_o [mH]
Modbus, active Terminals A / B	U_N [V]	I_N [mA]	U_N [V]	I_N [mA]	U_M [V]	I_M [mA]	U_o [V]	I_o [mA]				
	3	30	3	30	30	30	4.2	150	150	0	0	0
							U_i [V]	I_i [mA]	P_i [mW]	C_i [nF]	$C_{i pa}$ [nF]	L_i [mH]
Digital output DO1, passive Terminals 41 / 42							± 4.2	150	150	0	0	0
	30	25	30	25	30	25	30	25	187	2.4	2.4	0.2
Digital output DO2, passive Terminals 51 / 52	30	25	30	25	30	25	30	25	187	20	0	0.2

All outputs are electrically isolated from each other and from the power supply.

Digital outputs DO1 / DO2 are not electrically isolated from each other. Terminals 42 / 52 have the same potential.

CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

Special connection conditions

NOTICE

If the protective conductor (PE) is connected in the flowmeter's terminal box, you must ensure that no dangerous potential difference can arise between the protective conductor (PE) and the equipotential bonding (PA) in the hazardous area.

The output circuits are designed so that they can be connected to both intrinsically-safe and non-intrinsically-safe circuits.




- It is not permitted to combine intrinsically safe and non-intrinsically safe circuits.
- On intrinsically-safe circuits, equipotential bonding must be in place along the entire length of the cable used for the digital outputs.
- The rated voltage of the non-intrinsically safe circuits is $U_M = 30$ V.
- Provided that the rated voltage $U_M = 30$ V is not exceeded if connections are established to non-intrinsically safe external circuits, intrinsic safety is preserved.
- When changing the type of protection, the information in the corresponding chapter entitled "Changing the type of protection" in the operating instructions must be observed.

Use in potentially explosive atmospheres in accordance with cFMus

NOTICE

Further information on the approval of devices for use in potentially explosive atmospheres can be found in the type examination certificates or the relevant certificates at www.abb.com/flow.

Device overview

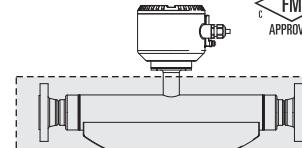	Standard / No explosion protection	Class I Div. 2 Zone 2, 21	Class I Div. 1 Zone 0, 1, 20, 21
Model number	FCx1xx Y0	FCx1xx F2	FCx1xx F1
– Standard – Class I Div. 2 – Class I Div. 1 – Zone 2, 21 – Zone 1, 21 – Zone 0, 20	 G11605a	 G11605b	 G11605c

Ex-marking

NOTICE

- Depending on the design, a specific marking in accordance with FM applies.
- ABB reserves the right to modify the Ex-marking. Refer to the name plate for the exact marking.

Marking for model FCx1xx-F2... in Zone 2, Div. 2

FM (marking for US)	FM (marking for Canada)
NI: CL I, DIV2, GPS ABCD, T6 ... T2 NI: CL II, III, DIV2, GPS EFG, T6 ... T3B DIP: CL II, Div 1, GPS EFG, T6 ... T3B DIP: CL III, Div 1, 2, T6 ... T3B CL I, ZN 2, AEx nA nR IIC T6 ... T2 ZN 21 AEx tb IIIC T85°C ... T165°C See instructions for T-Class information	NI: CL I, DIV2, GPS ABCD, T6 ... T2 NI: CL II, III, DIV2, GPS EFG, T6 ... T3B DIP: CL II, Div 1, GPS EFG, T6 ... T3B DIP: CL III, Div 1, 2, T6 ... T3B Ex nA IIC T6 ... T2 See instructions for T-Class information

Marking for model FCx1xx-F1... in Zone 1, Div. 1

FM (marking for US)	FM (marking for Canada)
NI: CL I, DIV2, GPS ABCD, T6 ... T2 NI: CL II, III, DIV2, GPS EFG, T6 ... T3B XP-IS: CL I, Div 1, GPS BCD, T6 ... T2 DIP: CL II, Div 1, GPS EFG, T6 ... T3B DIP: CL III, Div 1, 2, T6 ... T3B CL I, ZN 1, AEx d ia IIB+H2 T6 .. T2 ZN 21 AEx ia tb IIIC T85°C to T165°C See instructions for T-Class information Control Installation Drawing No. 3KXF000014G0009	NI: CL I, DIV2, GPS ABCD, T6 ... T2 NI: CL II, III, DIV2, GPS EFG, T6 ... T3B XP-IS: CL I, Div 1, GPS BCD, T6 ... T2 DIP: CL II, Div 1, GPS EFG, T6 ... T2 DIP: CL III, Div 1, 2, T6 ... T3B Ex d ia IIB+H2 T6 .. T2 Ex ia INTRINSICALLY SAFE SECURITE INTRINSEQU See instructions for T-Class information Control Installation Drawing No. 3KXF000014G0009

CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

Temperature data

Temperature resistance for the connecting cable

The temperature at the cable entries of the device is dependent on the measuring medium temperature T_{medium} and the ambient temperature T_{amb} .

For the electrical connection of the device, only use cables with sufficient temperature resistance according to the following diagram or table.

Devices with a maximum ambient temperature T_{amb} . 55 °C (131 °F)

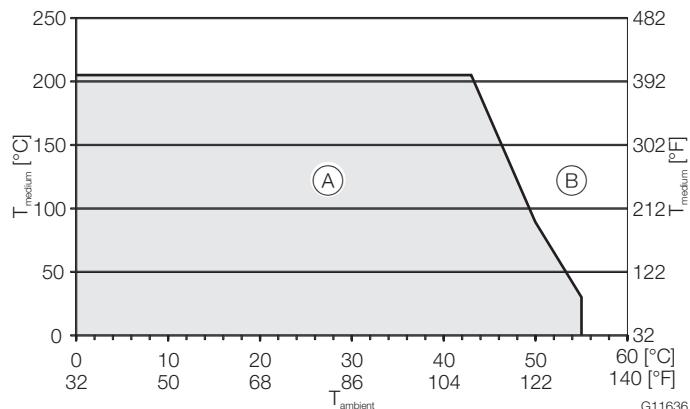


Fig. 26: Temperature range for the cable

- (A) Temperature resistance ≥ 70 °C (158 °F)
- (B) Temperature resistance ≥ 80 °C (176 °F)

Devices with a maximum ambient temperature T_{amb} . 70 °C (158 °F)

T_{amb}	Temperature resistance for the connecting cable
≤ 50 °C (≤ 122 °F)	≥ 70 °C (≥ 158 °F)
≤ 60 °C (≤ 140 °F)	≥ 80 °C (≥ 176 °F)
≤ 70 °C (≤ 158 °F)	≥ 90 °C (≥ 194 °F)

Above an ambient temperature of $T_{\text{amb}} \geq 60$ °C (≥ 140 °F), the wires in the connection box must be insulated with the enclosed silicone hoses.

Devices with a maximum ambient temperature T_{amb} . 55 °C (131 °F)

The temperature data stated on this page only applies to devices with a maximum permitted ambient temperature of T_{amb} . 55 °C (131 °F) (order code ambient temperature rangeTA8)!

Environmental and process conditions for model FCx1xx...

Ambient temperature		Measuring medium temperature	IP rating / NEMA rating
[T_{amb}]	[$T_{\text{amb, optional}}$]	[T_{medium}]	
-20 ... 55 °C (-4 ... 131 °F)	-40 ... 55 °C (-40 ... 131 °F)	-40 ... 205 °C (-40 ... 400 °F)	IP 64, IP 65, IP 67, IP 68 and NEMA 4X / type 4X

NOTICE

All cable conduits (conduits) must be sealed within a distance of 18 inches (450 mm) from the device.

Measuring medium temperature (Ex data) for model FCx1xx-F1... in Class I Div. 1, Class I Zone 1

Ambient temperature [T_{amb}]	≤ 50 °C (≤ 122 °F)	≤ 55 °C (≤ 131 °F)
Temperature class	Maximum permissible measuring medium temperature [T_{medium}]	
T1	205 °C (400 °F)	205 °C (400 °F)
T2	205 °C (400 °F)	205 °C (400 °F)
T3	195 °C (383 °F)	195 °C (383 °F)
T4	130 °C (266 °F)	130 °C (266 °F)
T5	95 °C (203 °F)	95 °C (203 °F)
T6	80 °C (176 °F)	80 °C (176 °F)

Measuring medium temperature (Ex data) for model FCx1xx-F2... in Class I Div. 2, Class I Zone 2

Ambient temperature [T_{amb}]	≤ 50 °C (≤ 122 °F)	≤ 55 °C (≤ 131 °F)
Temperature class	Maximum permissible measuring medium temperature [T_{medium}]	
T1	205 °C (400 °F)	205 °C (400 °F)
T2	205 °C (400 °F)	205 °C (400 °F)
T3	195 °C (383 °F)	195 °C (383 °F)
T4	130 °C (266 °F)	130 °C (266 °F)
T5	95 °C (203 °F)	95 °C (203 °F)
T6	80 °C (176 °F)	80 °C (176 °F)

Measuring medium temperature (Ex data) for model FCx1xx-F1... in Zone 21, Class II / III and FCx1xx-F2... in Zone 22, Class II / III

Ambient temperature [T_{amb}]	≤ 50 °C (≤ 122 °F)	≤ 55 °C (≤ 131 °F)
Temperature class	Maximum permissible measuring medium temperature [T_{medium}]	
T165°C	160 °C (320 °F)	160 °C (320 °F)
T135°C	130 °C (266 °F)	130 °C (266 °F)
T100°C	95 °C (203 °F)	95 °C (203 °F)
T85°C	80 °C (176 °F)	—

CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

Devices with a maximum ambient temperature T_{amb} . 70 °C (158 °F)

The temperature data stated on this page only applies to devices with a maximum permitted ambient temperature of T_{amb} . 70 °C (158 °F) (order code ambient temperature range TA3 / TA9)!

Environmental and process conditions for model FCx1xx...

Ambient temperature	Measuring medium temperature	IP rating / NEMA rating
[T_{amb}]	[T_{medium}]	
-20 ... 70 °C (-4 ... 158 °F)	-40 ... 205 °C (-40 ... 400 °F)	IP 65, IP 67, IP 68 and NEMA 4X / type 4X

NOTICE

All cable conduits (conduits) must be sealed within a distance of 18 inches (450 mm) from the device.

Measuring medium temperature (Ex data) for model FCx1xx-F1... in Class I Div. 1, Class I Zone 1

Ambient temperature [T_{amb}]	≤30 °C (≤86 °F)	≤50 °C (≤122 °F)	≤60 °C (≤140 °F)	≤70 °C (≤158 °F)
Temperature class	Maximum permissible measuring medium temperature [T_{medium}]			
T1	205 °C (400 °F)	205 °C (400 °F)	205 °C (400 °F)	205 °C (400 °F)
T2	205 °C (400 °F)	205 °C (400 °F)	205 °C (400 °F)	205 °C (400 °F)
T3	195 °C (383 °F)	195 °C (383 °F)	195 °C (383 °F)	195 °C (383 °F)
T4	130 °C (266 °F)	130 °C (266 °F)	130 °C (266 °F)	130 °C (266 °F)
T5	95 °C (203 °F)	95 °C (203 °F)	95 °C (203 °F)	95 °C (203 °F)
T6	80 °C (176 °F)	80 °C (176 °F)	80 °C (176 °F)	—

Measuring medium temperature (Ex data) for model FCx1xx-F2... in Class I Div. 2, Class I Zone 2

Ambient temperature [T_{amb}]	≤30 °C (≤86 °F)	≤50 °C (≤122 °F)	≤60 °C (≤140 °F)	≤70 °C (≤158 °F)
Temperature class	Maximum permissible measuring medium temperature [T_{medium}]			
T1	205 °C (400 °F)	205 °C (400 °F)	205 °C (400 °F)	205 °C (400 °F)
T2	205 °C (400 °F)	205 °C (400 °F)	205 °C (400 °F)	205 °C (400 °F)
T3	195 °C (383 °F)	195 °C (383 °F)	195 °C (383 °F)	195 °C (383 °F)
T4	130 °C (266 °F)	130 °C (266 °F)	130 °C (266 °F)	130 °C (266 °F)
T5	95 °C (203 °F)	95 °C (203 °F)	—	—
T6	80 °C (176 °F)	—	—	—

Measuring medium temperature (Ex data) for model FCx1xx-F1... in Zone 21, Class II / III and FCx1xx-F2... in Zone 22, Class II / III

Ambient temperature [T_{amb}]	≤30 °C (≤86 °F)	≤50 °C (≤122 °F)	≤60 °C (≤140 °F)	≤70 °C (≤158 °F)
Temperature class	Maximum permissible measuring medium temperature [T_{medium}]			
T210°C	205 °C (400 °F)	205 °C (400 °F)	205 °C (400 °F)	205 °C (400 °F)
T200°C	195 °C (383 °F)	195 °C (383 °F)	195 °C (383 °F)	195 °C (383 °F)
T135°C	130 °C (266 °F)	130 °C (266 °F)	130 °C (266 °F)	130 °C (266 °F)
T100°C	95 °C (203 °F)	95 °C (203 °F)	—	—
T85°C	80 °C (176 °F)	80 °C (176 °F)	—	—

Electrical data

Modbus outputs and digital outputs

Devices with a maximum ambient temperature T_{amb} . 55 °C (131 °F)

The electrical data stated in the following tables only applies to devices with a maximum permitted ambient temperature of T_{amb} . 55 °C (131 °F) (order code ambient temperature rangeTA8)!

Model: FCx1xx-F1, FCx1xx-F2

Outputs	Operating values (general)		Type of protection									
			NI (Div. 2, Zone 2)		XP (Div. 1, Zone 1)		IS (Div. 1, Zone 1)					
	U _N [V]	I _N [mA]	U _N [V]	I _N [mA]	U _M [V]	I _M [mA]	U _O [V]	I _O [mA]	P _O [mW]	C _O [nF]	C _{O PA} [nF]	L _O [mH]
Modbus, active Terminals A / B	3	30	3	30	30	30	4.2	150	150	0	0	0
							U _i [V]	I _i [mA]	P _i [mW]	C _i [nF]	C _{i pa} [nF]	L _i [mH]
							±4.2	150	150	0	0	0
Digital output DO1, passive Terminals 41 / 42	30	25	30	25	30	25	30	25	187	2.4	2.4	0.2
Digital output DO2, passive Terminals 51 / 52	30	25	30	25	30	25	30	25	187	10	0	0.2

All outputs are electrically isolated from each other and from the power supply.

Digital outputs DO1 / DO2 are not electrically isolated from each other. Terminals 42 / 52 have the same potential.

Devices with a maximum ambient temperature T_{amb} . 70 °C (158 °F)

The electrical data stated in the following tables only applies to devices with a maximum permitted ambient temperature of T_{amb} . 70 °C (158 °F) (order code ambient temperature rangeTA3 / TA9)!

Model: FCx1xx-F1, FCx1xx-F2

Outputs	Operating values (general)		Type of protection									
			NI (Div. 2, Zone 2)		XP (Div. 1, Zone 1)		IS (Div. 1, Zone 1)					
	U _N [V]	I _N [mA]	U _N [V]	I _N [mA]	U _M [V]	I _M [mA]	U _O [V]	I _O [mA]	P _O [mW]	C _O [nF]	C _{O PA} [nF]	L _O [mH]
Modbus, active Terminals A / B	3	30	3	30	30	30	4.2	150	150	0	0	0
							U _i [V]	I _i [mA]	P _i [mW]	C _i [nF]	C _{i pa} [nF]	L _i [mH]
							±4.2	150	150	0	0	0
Digital output DO1, passive Terminals 41 / 42	30	25	30	25	30	25	30	25	187	2.4	2.4	0.2
Digital output DO2, passive Terminals 51 / 52	30	25	30	25	30	25	30	25	187	20	0	0.2

All outputs are electrically isolated from each other and from the power supply.

Digital outputs DO1 / DO2 are not electrically isolated from each other. Terminals 42 / 52 have the same potential.

CoriolisMaster FCB130, FCB150, FCH130, FCH150

Coriolis mass flowmeter

Special connection conditions

The output circuits are designed so that they can be connected to both intrinsically-safe and non-intrinsically-safe circuits.

- It is not permitted to combine intrinsically safe and non-intrinsically safe circuits.
- On intrinsically-safe circuits, equipotential bonding must be in place along the entire length of the cable used for the digital outputs.
- The rated voltage of the non-intrinsically safe circuits is $U_M = 30$ V.
- Provided that the rated voltage $U_M = 30$ V is not exceeded if connections are established to non-intrinsically safe external circuits, intrinsic safety is preserved.
- When changing the type of protection, the information in the corresponding chapter entitled "Changing the type of protection" in the operating instructions must be observed.

NOTICE

If the protective conductor (PE) is connected in the flowmeter's terminal box, you must ensure that no dangerous potential difference can arise between the protective conductor (PE) and the equipotential bonding (PA) in the hazardous area.

Trademarks

® Modbus is a registered trademark of the Modbus Organization

™ Hastelloy C-4 is a Haynes International trademark

™ Hastelloy C-22 is a Haynes International trademark

Questionnaire

Customer:	Date:
Ms. / Mr.:	Department:
Telephone:	Fax:

Measuring medium:	Liquid content:	Gas content:
Flow rate: (min., max., operating point)	kg/h	
Density: (min., max., operating point)	kg/m ³	
Dynamic viscosity: (min., max., operating point)	mPas/cP	
Measuring medium temperature: (min., max., operating point)	°C	
Ambient temperature	°C	
Pressure: (min., max., operating point)	bar	
Rate of flow:	<input type="checkbox"/> Steady	<input type="checkbox"/> Pulsating
Batch operation:	<input type="checkbox"/> Yes	<input type="checkbox"/> No
Concentration calculation:	<input type="checkbox"/> Yes	<input type="checkbox"/> No
Transmitter design:	<input type="checkbox"/> Integral mount design	<input type="checkbox"/> Remote mount design
Explosion protection:	<input type="checkbox"/> Yes	<input type="checkbox"/> No
Power supply:	<input type="checkbox"/> 11 ... 30 V DC	
Electrical outputs:	Communication: <input type="checkbox"/> Pulse output, passive <input type="checkbox"/> Modbus-RTU, RS 485	
Additional specifications:		
Pipeline diameter:mm	
Process connection:	

Notes

Notes

Contact us

ABB Limited

Measurement & Analytics

Howard Road, St. Neots

Cambridgeshire, PE19 8EU

UK

Tel: +44 (0)870 600 6122

Fax: +44 (0)1480 213 339

Mail: enquiries.mp.uk@gb.abb.com

ABB Inc.

Measurement & Analytics

125 E. County Line Road

Warminster, PA 18974

USA

Tel: +1 215 674 6000

Fax: +1 215 674 7183

ABB Automation Products GmbH

Measurement & Analytics

Dransfelder Str. 2

37079 Goettingen

Germany

Tel: +49 551 905-0

Fax: +49 551 905-777

Mail: vertrieb.messtechnik-produkte@de.abb.com

www.abb.com/flow

Note

We reserve the right to make technical changes or modify the contents of this document without prior notice.

With regard to purchase orders, the agreed particulars shall prevail. ABB does not accept any responsibility whatsoever for potential errors or possible lack of information in this document.

We reserve all rights in this document and in the subject matter and illustrations contained therein. Any reproduction, disclosure to third parties or utilization of its contents – in whole or in parts – is forbidden without prior written consent of ABB.

Copyright© 2017 ABB
All rights reserved

3KXF411009R1001



Sales



Service